

CRAWFORD COUNTY PROJECT NO. DS-24(4)  
8441-10N

Letting Date MAY 13, 1997

IF ARCHAEOLOGICAL MATERIALS ARE ENCOUNTERED DURING THE CONSTRUCTION PHASE OF THIS PROJECT, THE ENGINEER MUST BE CONTACTED IMMEDIATELY SO THE PROPER AUTHORITIES CAN BE NOTIFIED ACCORDING TO THE EXISTING FEDERAL REGULATIONS AND STATE PROCEDURES. ADDITIONALLY, IT SHOULD BE NOTED THAT FINDINGS AND RECOMMENDATIONS FOR CLEARANCE FOR FURTHER TESTING CANNOT BE CONSIDERED FINAL UNTIL CONCURRENCE IS RECEIVED FROM THE OFFICE OF THE STATE HISTORIC PRESERVATION OFFICER.

OFFICE OF PROJECT PLANNING 515-239-1225  
OFFICE OF LOCAL SYSTEMS 515-239-1528

THIS PROJECT IS COVERED BY THE CORPS OF ENGINEERS  
NATIONWIDE PERMIT NUMBERS 13 & 26 AND  
IOWA DEPARTMENT OF NATURAL RESOURCES FLOOD PLAN  
DEVELOPMENT PERMIT NO. \_\_\_\_\_

IOWA  
DEPARTMENT OF TRANSPORTATION  
Project Development Division  
PLANS OF PROPOSED IMPROVEMENT ON THE  
**SECONDARY ROAD SYSTEM**  
**CRAWFORD COUNTY**  
STREAM CHANNEL STABILIZATION STRUCTURE  
PROJECT NO. DS-24(4)

The Standard Specifications, Series of 1992 of the Iowa Department of Transportation Shall Apply to Construction Work on this Project  
Plus Current Special Provisions and Supplemental Specifications


Scales: As Noted

Proj. No. DS-24(4)

INDEX OF SHEETS	
NO.	DESCRIPTION
A.01	TITLE SHEET
B.01	CONSTRUCTION SPECIFICATIONS
B.02-03	TYPICAL SECTIONS
C.01	ESTIMATED PROJECT QUANTITIES AND GENERAL INFORMATION
D.01	PLAN VIEW
W.01-03	CROSS SECTIONS - CHANNEL

MILEAGE SUMMARY
LOCATION
NEAR NORTH LINE NW1/4 NW1/4 SEC. 10-84-41 OVER MIDDLE SOLDIER RIVER

ROAD STANDARD PLANS					
The following Standard Plans shall be considered applicable to construction work on this project.					
Identification	Date	Identification	Date	Identification	Date

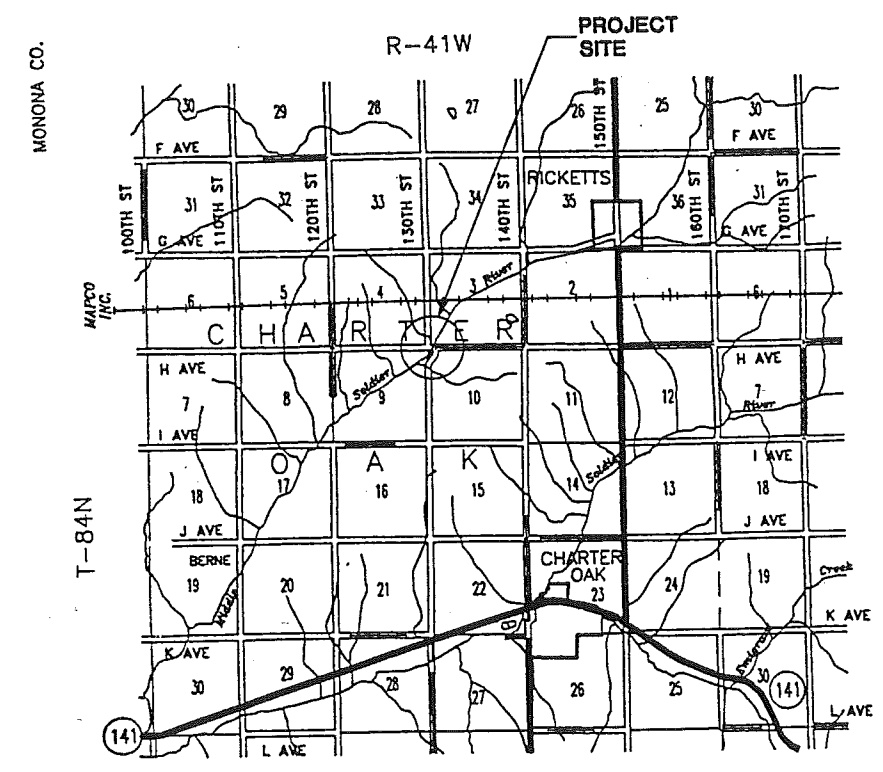

LOCATION MAP  
0 1 2 3  
SCALE IN MILES

TRAFFIC CONTROL PLAN

THROUGH TRAFFIC WILL BE MAINTAINED AT ALL TIMES DURING CONSTRUCTION. LOCAL TRAFFIC TO ADJACENT PROPERTIES WILL BE MAINTAINED AS PROVIDED FOR IN ARTICLE 1107.08 OF THE CURRENT STANDARD SPECIFICATIONS. TRAFFIC CONTROL DEVICES, PROCEDURES AND LAYOUTS SHALL BE AS PER PART VI OF THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) REVISION 3, DATED SEPTEMBER 3, 1993.

1988 AADT 15-40 V.P.D.

I hereby certify that the engineering document was prepared by me or under my direct personal supervision and that I am a duly Registered Professional Engineer under the laws of the State of Iowa.  
*Paul V. Assman*  
Paul V. Assman, P.E. #11982  
Date 8/27/96  
My registration expires December 31, 1996

Approved  
*Michael J. Gorton*  
*Robert D. Lohman*  
*Al. Dean Hargens*  
*Trigil E. Anderson*  
*John P. Lawler*  
BOARD OF SUPERVISORS

Approved By *Mark Jensen* Date 7/24/97  
NRCS State Conservation Engineer

Approved  
*H. Delbert Wright* 9-3-96  
Crawford County Engineer Date

Iowa Department of Transportation  
Project Development Division  
Accepted for Letting  
Transportation Center Local Systems Engineer Date

# CONSTRUCTION SPECIFICATIONS

## CONCRETE GROUT

### 1. SCOPE

THE WORK SHALL CONSIST OF FURNISHING, TRANSPORTING, AND PLACING CONCRETE GROUT IN THE CONSTRUCTION OF GROUTED ROCK RIPRAP SECTIONS SHOWN ON THE DRAWINGS.

### 2. MATERIALS

PORTLAND CEMENT SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M 85, TYPE 1.

POZZOLAN, UNLESS OTHERWISE SPECIFIED IN SECTION 10 OF THIS SPECIFICATION, POZZOLANS CONFORMING TO SPECIFICATION ASTM C-618 CLASS F IN AMOUNTS NOT TO EXCEED 20 PERCENT, BASED ON ABSOLUTE VOLUME, MAY BE SUBSTITUTED FOR AN EQUIVALENT AMOUNT OF PORTLAND CEMENT IN THE GROUT MIXTURE.

AGGREGATES SHALL CONFORM TO THE REQUIREMENTS OF ASTM SPECIFICATION C-33.

WATER SHALL BE CLEAN AND FREE FROM INJURIOUS AMOUNTS OF OILS, ACID, ALKALI, ORGANIC MATTER OR OTHER DELETERIOUS SUBSTANCES.

AIR-ENTRAINING ADMIXTURES SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M 154.

CURING COMPOUND SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M 148.

OTHER ADMIXTURES, WHEN REQUIRED, SHALL BE AS SPECIFIED IN THE CONSTRUCTION DETAILS.

### 3. DESIGN OF THE GROUT MIX

THE MIX PROPORTIONS FOR THE GROUT MIX SHALL BE AS SPECIFIED IN THE CONSTRUCTION DETAILS. DURING THE COURSE OF THE WORK THE ENGINEER WILL REQUIRE ADJUSTMENT OF THE MIX PROPORTIONS WHENEVER NECESSARY. AFTER THE MIX HAS BEEN DESIGNATED, IT SHALL NOT BE CHANGED WITHOUT THE APPROVAL OF THE ENGINEER.

### 4. HANDLING AND MEASUREMENT OF MATERIAL

MATERIALS SHALL BE STOCKPILED AND BATCHED BY METHODS THAT WILL PREVENT SEGREGATION OR CONTAMINATION OF AGGREGATES AND INSURE ACCURATE PROPORTIONING OF THE INGREDIENTS OF THE MIX.

EXCEPT AS OTHERWISE PROVIDED IN SECTION 8, CEMENT AND AGGREGATES SHALL BE MEASURED AS FOLLOWS:

CEMENT SHALL BE MEASURED BY WEIGHT OR IN BAGS OF 94 POUNDS EACH. WHEN CEMENT IS MEASURED IN BAGS, NO FRACTION OF A BAG SHALL BE USED UNLESS WEIGHED.

AGGREGATES SHALL BE MEASURED BY WEIGHT. MIX PROPORTIONS SHALL BE BASED ON SATURATED, SURFACE-DRY WEIGHTS. THE BATCH WEIGHT OF EACH AGGREGATE SHALL BE THE REQUIRED SATURATED, SURFACE-DRY WEIGHT PLUS THE WEIGHT OF SURFACE MOISTURE IT CONTAINS.

WATER SHALL BE MEASURED BY VOLUME OR BY WEIGHT, TO AN ACCURACY WITHIN ONE PERCENT OF THE TOTAL QUANTITY OF WATER REQUIRED FOR THE BATCH.

ADMIXTURES SHALL BE MEASURED WITHIN A LIMIT OF ACCURACY OF  $\pm 3$  PERCENT.

### 5. MIXERS AND MIXING

THE MIXER, WHEN LOADED TO CAPACITY, SHALL BE CAPABLE OF COMBINING THE INGREDIENTS OF THE GROUT MIX INTO A THOROUGHLY MIXED AND UNIFORM MASS AND OF DISCHARGING IT WITH A SATISFACTORY DEGREE OF UNIFORMITY.

MIXER SHALL BE OPERATED WITHIN THE LIMITS OF THE MANUFACTURER'S GUARANTEED CAPACITY AND SPEED OF ROTATION.

THE TIME OF MIXING AFTER ALL CEMENT AND AGGREGATES ARE IN THE MIXER DRUM SHALL BE NOT LESS THAN ONE MINUTE FOR MIXERS HAVING A CAPACITY OF ONE CUBIC YARD OR LESS. FOR MIXERS OF LARGER CAPACITIES, THE MINIMUM TIME SHALL BE INCREASED FIFTEEN SECONDS FOR EACH CUBIC YARD OR FRACTION THEREOF OF ADDITIONAL CAPACITY. THE BATCH SHALL BE SO CHARGED INTO THE MIXER THAT SOME WATER WILL ENTER IN ADVANCE OF CEMENT AND AGGREGATE, AND ALL MIXING WATER SHALL BE INTRODUCED INTO THE DRUM BEFORE ONE-FOURTH OF THE MIXING TIME HAS ELAPSED.

WHEN READY-MIXED GROUT MIX IS FURNISHED, THE CONTRACTOR SHALL FURNISH TO THE ENGINEER A DELIVERY TICKET SHOWING THE TIME OF LOADING AND THE QUANTITIES OF MATERIALS USED FOR EACH LOAD OF GROUT MIX.

NO MIXING WATER IN EXCESS OF THE AMOUNT CALLED FOR BY THE JOB MIX SHALL BE ADDED TO THE GROUT MIX DURING MIXING OR HAULING OR AFTER ARRIVAL AT THE DELIVERY POINT.

### 6. CONVEYING AND PLACING

THE GROUT MIX SHALL BE DELIVERED TO THE SITE AND PLACED WITHIN 1-1/2 HOURS AFTER THE INTRODUCTION OF THE CEMENT TO THE AGGREGATES. IN HOT WEATHER OR UNDER CONDITIONS CONTRIBUTING TO QUICK STIFFENING OF THE CONCRETE, THE TIME BETWEEN THE INTRODUCTION OF THE CEMENT TO THE AGGREGATES AND DISCHARGE SHALL NOT EXCEED 45 MINUTES. THE ENGINEER MAY ALLOW A LONGER TIME, PROVIDED THE SETTING TIME OF THE CONCRETE IS INCREASED A CORRESPONDING AMOUNT BY THE ADDITION OF AN APPROVED SET-RETARDING MIXTURE. IN ANY CASE, CONCRETE SHALL BE CONVEYED FROM THE MIXER TO THE FINAL PLACEMENT AS RAPIDLY AS PRACTICABLE BY METHODS THAT WILL PREVENT SEGREGATION OF THE AGGREGATES OR LOSS OF MORTAR.

GROUT MIX SHALL NOT BE DROPPED MORE THAN 5 FEET VERTICALLY UNLESS SUITABLE EQUIPMENT IS USED TO PREVENT SEGREGATION.

THE GROUT MIX SHALL NOT BE PLACED UNTIL THE ROCK RIPRAP HAS BEEN INSPECTED AND APPROVED BY THE ENGINEER.

ROCK TO BE GROUTED SHALL BE KEPT WET FOR AT LEAST 2 HOURS IMMEDIATELY PRIOR TO GROUTING.

THE ROCK RIPRAP SHALL BE FLUSHED WITH WATER TO REMOVE THE FINES FROM THE ROCK PRIOR TO PLACING THE GROUT. THE ROCK SHALL BE KEPT MOIST JUST AHEAD OF THE ACTUAL PLACING, BUT THE GROUT SHALL NOT BE PLACED IN STANDING OR FLOWING WATER. GROUT PLACED ON INVERTS OR OTHER NEARLY LEVEL AREAS MAY BE PLACED IN ONE COURSE. ON SLOPES, THE GROUT SHALL BE PLACED IN TWO (2) COURSES IN SUCCESSIVE LATERAL STRIPS APPROXIMATELY TEN (10) FEET IN WIDTH STARTING AT THE TOE OF THE SLOPE AND PROGRESSING TO THE TOP. THE GROUT SHALL BE DELIVERED TO THE PLACE OF FINAL DEPOSIT BY APPROVED MEANS AND DISCHARGED DIRECTLY ON THE SURFACE OF THE ROCK, USING A SPLASH PLATE OF METAL OR WOOD TO PREVENT DISPLACEMENT OF THE ROCK DIRECTLY UNDER THE DISCHARGE. THE FLOW OF GROUT SHALL BE DIRECTED WITH BROOMS, SPADES OR BAFFLES TO PREVENT IT FROM FLOWING EXCESSIVELY ALONG THE SAME PATH AND TO ASSURE THAT ALL INTERMITTENT SPACES ARE FILLED. SUFFICIENT BARRING SHALL BE DONE TO LOOSEN TIGHT POCKETS OF ROCK AND OTHERWISE AID THE PENETRATION OF GROUT SO THAT ALL VOIDS SHALL BE FILLED AND THE GROUT FULLY PENETRATES THE ROCK BLANKET. ALL BROOMING ON SLOPES SHALL BE UP HILL AND AFTER THE GROUT HAS STIFFENED, THE ENTIRE SURFACE SHALL BE REBROOMED TO ELIMINATE RUNS AND TO FILL VOIDS CAUSED BY SLOUGHING.

AFTER COMPLETION OF ANY STRIP OR PANEL, NO WORKMAN OR OTHER LOAD SHALL BE PERMITTED ON THE GROUTED SURFACE FOR A PERIOD OF TWENTY FOUR (24) HOURS. THE GROUTED SURFACE SHALL BE PROTECTED FROM INJURIOUS ACTION BY THE SUN, RAIN, FLOWING WATER AND MECHANICAL INJURY.

### 7. CURING AND PROTECTION

THE SURFACE OF TREATMENT MATERIALS SHALL BE PREVENTED FROM DRYING FOR A CURING PERIOD OF AT LEAST 7 DAYS AFTER IT IS PLACED. EXPOSED SURFACES SHALL BE KEPT CONTINUOUSLY MOIST FOR THE ENTIRE PERIOD, OR UNTIL CURING COMPOUND IS APPLIED AS SPECIFIED BELOW. MOISTURE SHALL BE MAINTAINED BY SPRINKLING, FLOODING OR FOG SPRAYING OR BY COVERING WITH CONTINUOUSLY MOISTENED CANVAS, CLOTH MATS, STRAW, SAND OR OTHER APPROVED MATERIAL. WATER OR COVERING SHALL BE APPLIED IN SUCH A WAY THAT THE CONCRETE SURFACE IS NOT ERODED OR OTHERWISE DAMAGED.

THE GROUTED ROCK MAY BE COATED WITH AN APPROVED CURING COMPOUND IN LIEU OF CONTINUED APPLICATION OF MOISTURE. THE COMPOUND SHALL BE SPRAYED ON THE MOIST CONCRETE SURFACES AS SOON AS FREE WATER HAS DISAPPEARED, BUT SHALL NOT BE APPLIED TO ANY SURFACE UNTIL FINISHING OF THAT SURFACE IS COMPLETED. THE COMPOUND SHALL BE APPLIED AT A UNIFORM RATE OF NOT LESS THAN ONE GALLON PER 150 SQUARE FEET OF SURFACE AND SHALL FORM A CONTINUOUS ADHERENT MEMBRANE OVER THE ENTIRE SURFACE. CURING COMPOUND SHALL NOT BE APPLIED TO SURFACES REQUIRING BOND TO SUBSEQUENTLY PLACED CONCRETE. IF THE MEMBRANE IS DAMAGED DURING THE CURING PERIOD, THE DAMAGED AREA SHALL BE RESPRAYED AT THE RATE OF APPLICATION SPECIFIED ABOVE.

GROUT MIX SHALL NOT BE PLACED WHEN THE DAILY MINIMUM TEMPERATURE IS LESS THAN 40° F UNLESS FACILITIES ARE PROVIDED TO INSURE THAT THE TEMPERATURE OF THE MATERIALS IS MAINTAINED AT NOT LESS THAN 50° F NOR MORE THAN 90° F DURING PLACEMENT AND THE CURING PERIOD. GROUT MIX SHALL NOT BE PLACED ON FROZEN SURFACES. WHEN FREEZING CONDITIONS PREVAIL, ROCK TO BE GROUTED MUST BE COVERED AND HEATED TO A RANGE OF 50° F TO 90° F FOR AT LEAST 24 HOURS PRIOR TO PLACING TREATMENT MATERIALS.

### 8. INSPECTING AND TESTING FRESH GROUT

THE ENGINEER WILL INSPECT AND TEST GROUT DURING THE COURSE OF THE WORK. SAMPLING OF FRESH GROUT WILL BE DONE BY THE METHODS PRESCRIBED IN ASTM DESIGNATION C 172. THE VOLUME OF EACH BATCH WILL BE DETERMINED BY THE METHODS PRESCRIBED IN ASTM DESIGNATION C 138.

THE ENGINEER SHALL HAVE FREE ENTRY TO ALL PARTS OF THE CONTRACTOR'S PLANT AND EQUIPMENT WHICH CONCERN MIXING AND PLACING THE GROUT WHILE WORK ON THE CONTRACT IS BEING PERFORMED. PROPER FACILITIES SHALL BE PROVIDED FOR THE ENGINEER TO INSPECT MATERIALS AND PROCESSES USED IN MIXING AND PLACING THE GROUT AS WELL AS FOR SECURING SAMPLES OF THE GROUT MIX. ALL TESTS AND INSPECTIONS SHALL BE SO CONDUCTED AS NOT TO INTERFERE UNNECESSARILY WITH THE MIXING AND PLACING OF THE GROUT.

WHEN READY-MIXED GROUT IS FURNISHED, THE CONTRACTOR SHALL FURNISH TO THE ENGINEER A STATEMENT-OF-DELIVERY TICKET FOR EACH BATCH DELIVERED TO THE JOB SITE. THE TICKET SHALL SHOW THE TOTAL WEIGHTS IN POUNDS OF CEMENT, WATER, AND FINE AND COARSE AGGREGATES, AMOUNT OF AIR-ENTRAINING AGENT, TIME OF LOADING, AND THE REVOLUTION COUNTER READING AT THE TIME OF BATCHING.

### 9. MEASUREMENT AND PAYMENT

FOR ITEMS OF WORK FOR WHICH SPECIFIC UNIT PRICES ARE ESTABLISHED IN THE CONTRACT, THE QUANTITY OF CONCRETE GROUT PLACED WITHIN THE SPECIFIED LIMITS WILL BE COMPUTED TO THE NEAREST 0.1 CUBIC YARD BY VOLUME. THE VOLUME OF GROUT WILL BE DETERMINED FROM THE SUMMATION OF ALL STATEMENT-OF-DELIVERY TICKETS FOR CONCRETE GROUT DELIVERED TO THE SITE AND ACCEPTABLY PLACED IN THE WORK.

PAYMENT FOR THE CONCRETE GROUT WILL BE MADE AT THE CONTRACT UNIT PRICE FOR EACH ITEM. SUCH PAYMENT WILL BE CONSIDERED FULL COMPENSATION FOR ALL LABOR, MATERIALS, EQUIPMENT, AND ALL OTHER ITEMS NECESSARY AND INCIDENTAL TO THE COMPLETION OF THE WORK.

COMPENSATION FOR ANY ITEM OF WORK DESCRIBED IN THE CONTRACT BUT NOT LISTED IN THE BID SCHEDULE WILL BE INCLUDED IN THE PAYMENT FOR THE ITEM OF WORK TO WHICH IT IS MADE SUBSIDIARY. SUCH ITEMS AND THE ITEMS TO WHICH THEY ARE MADE SUBSIDIARY ARE IDENTIFIED IN SECTION 10 OF THIS SPECIFICATION.

### 10. ITEMS OF WORK AND CONSTRUCTION DETAILS

ITEMS OF WORK TO BE PERFORMED IN CONFORMANCE WITH THIS SPECIFICATION AND THE CONSTRUCTION DETAILS THEREFOR ARE:

- (1) THIS ITEM SHALL CONSIST OF FURNISHING AND PLACING CONCRETE GROUT AS SHOWN ON THE DRAWINGS.
- (2) THE GROUTING MIXTURE SHALL BE AS FOLLOWS:
  - (A) CEMENT: TYPE I, TYPE I OR TYPE II WITH AN AIR ENTRAINING ADMIXTURE, 10 SACKS OR 940 LBS/C.Y.
  - (B) FINE CONCRETE AGGREGATE: 2,100 LBS/C.Y. (SURFACE DRY WEIGHT)
  - (C) WATER: 45 GAL/C.Y., OR ENOUGH TO PROVIDE A THICK CREAMY CONSISTENCY.
  - (D) AIR CONTENT: 6 TO 10 PERCENT.OTHER SIMILAR GROUT MIXES THAT INCORPORATE SMALL COARSE AGGREGATE MAY BE USED IF APPROVED IN ADVANCE BY THE ENGINEER.
- (3) FLY ASH CONFORMING TO ASTM C 618 CLASS F OR CLASS C, IN AMOUNTS NOT TO EXCEED 20 PERCENT BASED ON ABSOLUTE VOLUME, MAY BE SUBSTITUTED FOR AN EQUIVALENT AMOUNT OF PORTLAND CEMENT IN THE GROUT MIXTURE.
- (4) THE GROUT SHALL BE CONSOLIDATED INTO THE VOIDS WITH THE USE OF A CONCRETE VIBRATOR.
- (5) GROUTING OPERATION SHALL NOT BE PERFORMED EXCEPT IN THE PRESENCE OF THE ENGINEER.
- (6) A SMOOTH SURFACE IS NOT TO BE CREATED BY THE GROUTING OPERATIONS.
- (7) THE AVERAGE RATE OF GROUT APPLICATION SHALL BE 5.4 CUBIC FEET OF GROUT PER SQUARE YARD OF LOOSE ROCK RIPRAP.

## REMOVAL OF WATER

### 1. SCOPE

THE WORK SHALL CONSIST OF REMOVAL OF SURFACE WATER AND GROUND WATER AS NEEDED TO PERFORM THE REQUIRED CONSTRUCTION IN ACCORDANCE WITH THE SPECIFICATIONS. IT SHALL INCLUDE (1) BUILDING AND MAINTAINING ALL NECESSARY TEMPORARY DRAINAGE WORKS, CHANNELS, AND DIVERSIONS, (2) FURNISHING, INSTALLING AND OPERATING ALL NECESSARY PUMPS, PIPING AND OTHER FACILITIES AND EQUIPMENT, AND (3) REMOVING ALL SUCH TEMPORARY WORKS AND EQUIPMENT AFTER THEY HAVE SERVED THEIR PURPOSES.

### 2. DIVERTING SURFACE WATER

THE CONTRACTOR SHALL BUILD, MAINTAIN AND OPERATE ALL COFFERDAMS, CHANNELS, FLUMES, SUMPS, AND OTHER TEMPORARY DIVERSION AND PROTECTIVE WORKS NEEDED TO DIVERT STREAMFLOW AND OTHER SURFACE WATER THROUGH OR AROUND THE CONSTRUCTION SITE AND AWAY FROM THE CONSTRUCTION WORK WHILE CONSTRUCTION IS IN PROGRESS. UNLESS OTHERWISE SPECIFIED, A DIVERSION MUST DISCHARGE INTO THE SAME NATURAL DRAINAGEWAY IN WHICH ITS HEADWORKS ARE LOCATED.

UNLESS OTHERWISE SPECIFIED, THE CONTRACTOR SHALL FURNISH TO THE CONTRACTING OFFICER, IN WRITING, HIS PLAN FOR DIVERTING SURFACE WATER BEFORE BEGINNING THE CONSTRUCTION WORK FOR WHICH THE DIVERSION IS REQUIRED. ACCEPTANCE OF THIS PLAN WILL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR COMPLETING THE WORK AS SPECIFIED.

### 3. DEWATERING THE CONSTRUCTION SITE

FOUNDATIONS, CUTOFF TRENCHES AND OTHER PARTS OF THE CONSTRUCTION SITE SHALL BE DEWATERED AND KEPT FREE OF STANDING WATER OR EXCESSIVELY MUDDY CONDITIONS AS NEEDED FOR PROPER EXECUTION OF THE CONSTRUCTION WORK. THE CONTRACTOR SHALL FURNISH, INSTALL, OPERATE AND MAINTAIN ALL DRAINS, SUMPS, PUMPS, CASING, WELLPOINTS, AND OTHER EQUIPMENT NEEDED TO PERFORM THE DEWATERING AS SPECIFIED. DEWATERING METHODS THAT CAUSE A LOSS OF FINES FROM FOUNDATION AREAS WILL NOT BE PERMITTED.

UNLESS OTHERWISE SPECIFIED, THE CONTRACTOR SHALL FURNISH TO THE CONTRACTING OFFICER, IN WRITING, HIS PLAN FOR DEWATERING BEFORE BEGINNING THE CONSTRUCTION WORK FOR WHICH THE DEWATERING IS REQUIRED. ACCEPTANCE OF THIS PLAN WILL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR COMPLETING THE WORK AS SPECIFIED.

### 4. EROSION AND POLLUTION CONTROL

REMOVAL OF WATER FROM THE CONSTRUCTION SITE SHALL BE ACCOMPLISHED IN SUCH A MANNER THAT EROSION AND THE TRANSMISSION OF SEDIMENT AND OTHER POLLUTANTS ARE MINIMIZED.

### 5. REMOVAL OF TEMPORARY WORKS

AFTER THE TEMPORARY WORKS HAVE SERVED THEIR PURPOSES, THE CONTRACTOR SHALL REMOVE THEM OR LEVEL AND GRADE THEM TO THE EXTENT REQUIRED TO PRESENT A SIGHTLY APPEARANCE AND TO PREVENT ANY OBSTRUCTION OF THE FLOW OF WATER OR ANY OTHER INTERFERENCE WITH THE OPERATION OF OR ACCESS TO THE PERMANENT WORKS.

EXCEPT AS OTHERWISE SPECIFIED, PIPES AND CASINGS SHALL BE REMOVED FROM TEMPORARY WELLS AND THE WELLS SHALL BE FILLED TO GROUND LEVEL WITH GRAVEL OR OTHER MATERIAL APPROVED BY THE CONTRACTING OFFICER.


### 6. MEASUREMENT AND PAYMENT

PAYMENT FOR THIS ITEM WILL BE MADE AT THE CONTRACT LUMP SUM PRICE AND WILL CONSTITUTE FULL COMPENSATION FOR COMPLETION OF THE WORK.



**SUNDQUIST ENGINEERING, P.C.**  
CONSULTING ENGINEERS  
HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING  
120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442  
PHONE: (712)263-8118 FAX: (712)263-2181

PROJECT NO.:	0506	DATE:	8/96	REV:	
CLIENT:	CRAWFORD COUNTY, IOWA				
DRAWN BY:	TKK	REVIEWED BY:		APPROVED BY:	PJA
DESCRIPTION:	CONSTRUCTION SPECIFICATIONS				SHEET
	PROJ. NO. DS-24(4)				B.01




## SECTION A-A


## ROCK FILLED CUTOFF TRENCH DETAILS

CONTINUOUS ACROSS BOTTOM WIDTH AND SIDE SLOPES.


- \* 2.5' ACROSS CHANNEL BOTTOM  
2.0' ON SIDE SLOPES  
\*\* 1.5' ACROSS CHANNEL BOTTOM  
2.0' ON SIDE SLOPES




 <b>SUNDQUIST ENGINEERING, P.C.</b> CONSULTING ENGINEERS HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING 120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442 PHONE: (712)263-8118 FAX: (712)263-2181	PROJECT NO.: 0506		DATE: 6/96	REV: _____
	CLIENT: CRAWFORD COUNTY, IOWA			
	DRAWN BY: TKK	REVIEWED BY: _____	APPROVED BY: PJA	
	DESCRIPTION: TYPICAL SECTIONS			SHEET
	PROJ. NO. DS-24(4)			B.02

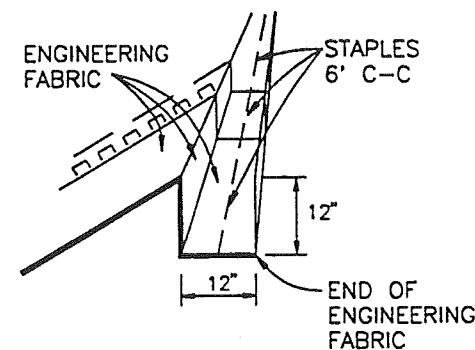

DETAIL OF TRENCH

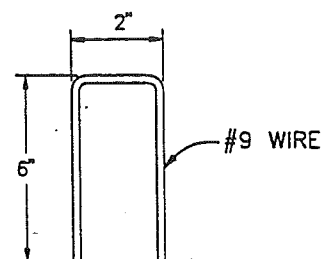


STAPLE

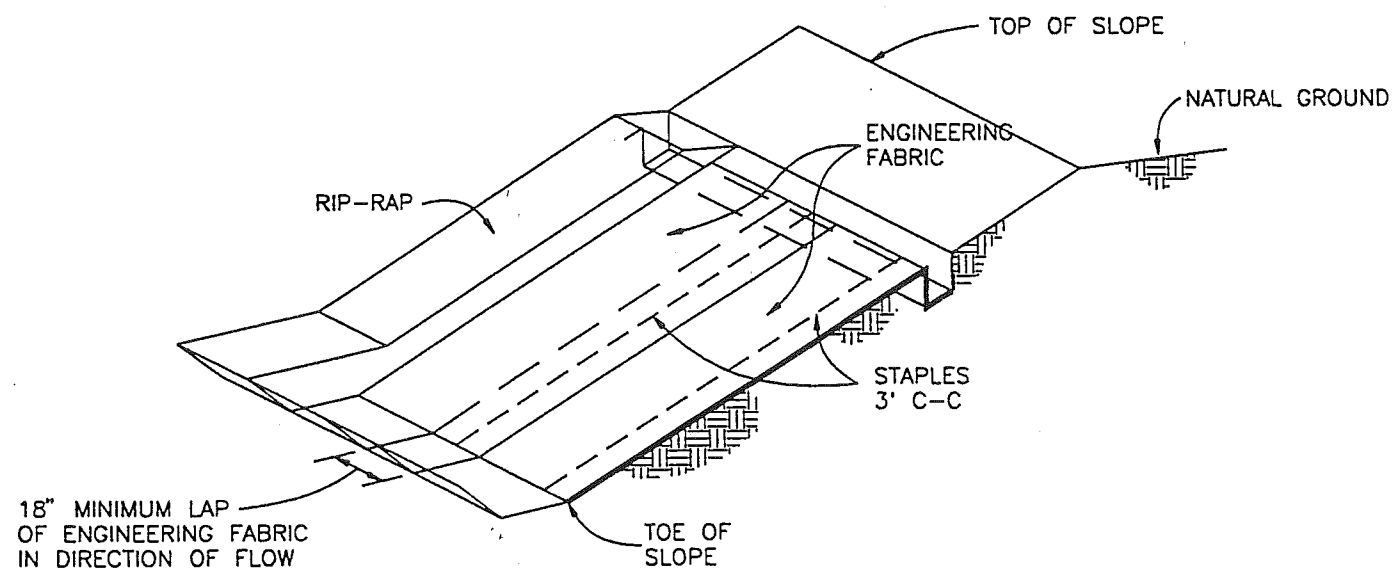


EXCAVATE 12"x12" TRENCH ALONG TOP OF RIPRAP. PLACE END OF ENGINEERING FABRIC STRIPS INTO TRENCH WITH STAPLES AS SHOWN. BACKFILL WITH THE EXCAVATED MATERIAL AND COMPACT. THE ENGINEER MAY PERMIT THE USE OF THE WHEELS OF PNEUMATIC-TIRED EQUIPMENT FOR CONSOLIDATING THE TRENCH BACKFILL MATERIAL.


## DETAILS OF PLACEMENT OF ENGINEERING FABRIC

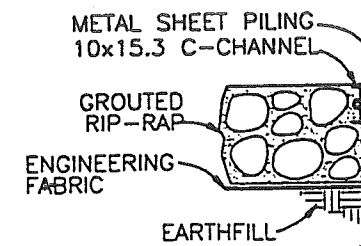


GROUTED RIP-RAP DETAIL

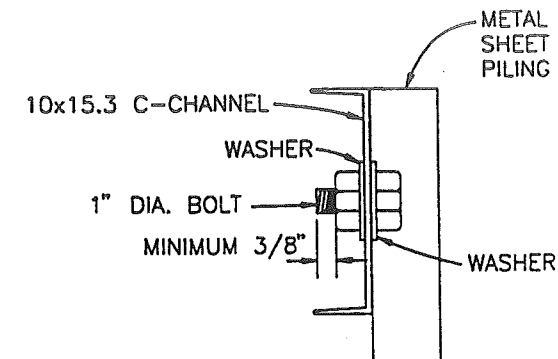

BOLT DETAIL



WATER BOLT PLACEMENT (HEAVY "Z" STYLE SHEETS)

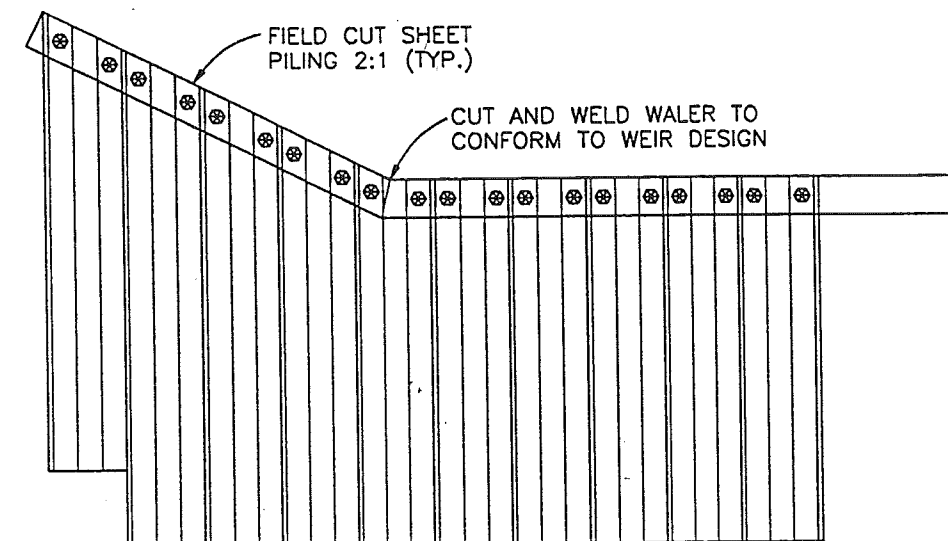

### NOTES:

1. ALL BOLTS SHALL BE 1" DIA. W/2 WASHERS. BOLTS WILL EXTEND AT MINIMUM 3/8" BEYOND NUT.
2. ALL HOLES SHALL BE FIELD DRILLED 1/16" DIA. LARGER THAN THE BOLTS.

## WALER DETAILS



**SUNDQUIST ENGINEERING, P.C.**  
CONSULTING ENGINEERS

HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING  
120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442  
PHONE: (712)263-8118 FAX: (712)263-2181

PROJECT NO.:	0506	DATE:	6/96	REV:	
CLIENT:	CRAWFORD COUNTY, IOWA				
DRAWN BY:	TKK	REVIEWED BY:		APPROVED BY:	PJA
DESCRIPTION:	TYPICAL SECTIONS				
	PROJ. NO. DS-24(4)				
					SHEET
					B.03

GENERAL NOTES

IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO MAKE ALL NECESSARY ARRANGEMENTS WITH ADJACENT PROPERTY OCCUPANTS FOR RESTRAINING LIVESTOCK FROM ENTERING THE RIGHT OF WAY.

ROAD CONTRACTOR IS TO USE DUE CAUTION IN WORKING OVER AND AROUND ALL TILE LINES. BREAKS IN THE TILE LINE DUE TO THE CONTRACTOR'S CARELESSNESS ARE TO BE REPLACED AT HIS EXPENSE WITHOUT COST TO THE COUNTY. ANY TILE LINES BROKEN OR DISTURBED BY CUT LINES WILL BE REPLACED AS DIRECTED BY THE ENGINEER IN CHARGE OF CONSTRUCTION AND AT THE COUNTY'S EXPENSE.

ALL BORROW AREAS, STOCKPILE AREAS, HAUL ROADS AND AREAS FOR MANEUVERING EQUIPMENT ON THIS PROJECT WILL REQUIRE SUBSOIL TILLAGE TO AN AVERAGE DEPTH OF 18 TO 24 INCHES. SUCH TILLAGE SHALL BE ACCOMPLISHED ON MAXIMUM OF THREE FOOT CENTERS. SUCH AREAS SHALL BE DESIGNATED BY THE COUNTY ENGINEER.

202-1  
THE CONTRACTOR'S ATTENTION IS DIRECTED TO THE FACT THAT ARCHAEOLOGICAL REMAINS MAY BE UNCOVERED ON THIS PROJECT. REFER TO SECTION 2102.10 OF THE STANDARD SPECIFICATIONS. THE ENGINEER SHALL NOTIFY BOTH THE OFFICE OF THE STATE ARCHAEOLOGIST IN IOWA CITY AND THE OFFICE OF PROJECT PLANNING, IOWA DOT A MINIMUM OF ONE WEEK PRIOR TO THE EXPECTED DATE OF THE START OF CONSTRUCTION ACTIVITIES.

213-1  
IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE WASTE AREAS OR DISPOSAL SITES FOR EXCESS MATERIAL (EXCAVATED MATERIAL OR BROKEN CONCRETE) WHICH IS NOT DESIRABLE TO BE INCORPORATED INTO THE WORK INVOLVED ON THIS PROJECT. NO PAYMENT FOR OVERHAUL WILL BE ALLOWED FOR MATERIAL HAULED TO THESE SITES. NO MATERIAL SHALL BE PLACED WITHIN THE RIGHT OF WAY, UNLESS SPECIFICALLY STATED IN THE PLANS OR APPROVED BY THE ENGINEER.

251-1  
THE CONTRACTOR SHALL BE RESPONSIBLE TO MAINTAIN ACCESS TO INDIVIDUAL PROPERTIES DURING CONSTRUCTION.

RELOCATED ACCESS SHALL BE COMPLETED TO INDIVIDUAL PROPERTIES PRIOR TO REMOVAL OF EXISTING ACCESS.

IF THE PERMANENT ACCESS CANNOT BE COMPLETED PRIOR TO REMOVAL OF THE EXISTING ACCESS, THE CONTRACTOR SHALL PROVIDE AND MAINTAIN AN ALTERNATE ACCESS. TEMPORARY GRANULAR SURFACING WILL BE PAID FOR AS A CONTRACT ITEM OR BY EXTRA WORK.

261-1  
WHERE PUBLIC UTILITY FIXTURES ARE SHOWN AS EXISTING ON THE PLANS OR ENCOUNTERED WITHIN THE CONSTRUCTION AREA, IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE OWNERS OF THOSE UTILITIES PRIOR TO THE BEGINNING OF ANY CONSTRUCTION. THE CONTRACTOR SHALL AFFORD ACCESS TO THESE FACILITIES FOR NECESSARY MODIFICATION OF SERVICES. UNDERGROUND FACILITIES, STRUCTURES AND UTILITIES HAVE BEEN PLOTTED FROM AVAILABLE SURVEYS AND RECORDS, AND THEREFORE THEIR LOCATIONS MUST BE CONSIDERED APPROXIMATE ONLY. IT IS POSSIBLE THERE MAY BE OTHERS, THE EXISTENCE OF WHICH IS PRESENTLY NOT KNOWN OR SHOWN. IT IS THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THEIR EXISTENCE AND EXACT LOCATION AND TO AVOID DAMAGE THERETO. NO CLAIMS FOR ADDITIONAL COMPENSATION WILL BE ALLOWED TO THE CONTRACTOR FOR ANY INTERFERENCE OR DELAY CAUSED BY SUCH WORK.

ESTIMATE REFERENCE INFORMATION

DATA LISTED BELOW IS FOR INFORMATIONAL PURPOSES ONLY AND SHALL NOT CONSTITUTE A BASIS FOR ANY EXTRA WORK ORDERS.

1. INCLUDES REMOVAL AND DISPOSAL OF TREES, DOWN TIMBER, LOGS, DRIFTS, DEBRIS AND OTHER OBSTRUCTIONS LYING WITHIN THE CONSTRUCTION LIMITS.
2. QUANTITY INCLUDES STRIPPING OF EXISTING VEGETATIVE COVER TO A DEPTH OF 6". THE STRIPPINGS AND ANY REMAINING CLASS 10 CHANNEL EXCAVATION NOT INCORPORATED IN THE EMBANKMENT FILL SHALL BE DISPOSED OF.  
  
PAYMENT WILL BE BASED ON PLAN QUANTITY.

ITEM ALSO INCLUDES APPROXIMATELY 2225 (1648 x 1.35) CY OF SUITABLE CLASS 10 CHANNEL EXCAVATION PLACED AS DIRECTED BY THE ENGINEER TO CONSTRUCT THE SLOPES OF THE STREAMBANKS AS SHOWN ON THE CROSS SECTIONS. THE COST OF THIS WORK SHALL BE INCLUDED IN AND CONSIDERED INCIDENTAL TO THE PRICE BID FOR EXCAVATION, CLASS 10, CHANNEL.

3. THIS ITEM SHALL CONSIST OF FURNISHING AND INSTALLING THE SHEET PILING AND WALER AS SHOWN ON THE DRAWINGS. THIS ITEM SHALL INCLUDE FIELD CUTTING THE SIDESLOPES OF THE SHEET PILING TO THE SPECIFIED 2:1 GRADE AS SHOWN ON THE DRAWINGS.  
  
THE SHEET PILING AND APPURTENANT METALWORK SHALL MEET THE REQUIREMENTS OF ASTM A328, A572 OR A690. THE SHEET PILING SHALL BE INSTALLED STARTING FROM THE CENTERLINE OF THE WEIR SECTION AND PROGRESSING AWAY FROM THE CENTERLINE.

SHEET PILING SHALL MEET THE FOLLOWING REQUIREMENTS:

- (a) MINIMUM SECTION MODULUS OF 19.4 CU. IN. PER FOOT OF
- (b) MINIMUM WALL THICKNESS OF 3/8 INCH.

4. SEE DRAWING SHEET B.03, DETAILS OF PLACEMENT OF ENGINEERING FABRIC, FOR INSTALLATION DETAILS. MATERIAL TO CONFORM TO IOWA DOT MATERIALS IM 496.01 APPENDIX A, EMBANKMENT EROSION CONTROL (SPECIFICATION 4196.01C)

ESTIMATED PROJECT QUANTITIES

ITEM NO.	ITEM	UNIT	TOTAL	AS BUILT QUAN.
1	CLEARING AND GRUBBING	UNIT	50	
2	EXCAVATION, CLASS 10, CHANNEL	CY	4205	
3	PILING, STEEL SHEET	SF	2400	
4	FABRIC, ENGINEERING	SY	1420	
5	REVETMENT, CLASS E, RIPRAP	TON	1420	
6	MOBILIZATION	LS	1	
7	SEEDING, FERTILIZING AND MULCHING	ACRE	1.0	
8	GROUT	CY	108	
9	REMOVAL OF WATER	LS	1	

5. THIS ITEM SHALL CONSIST OF FURNISHING AND PLACING REVETMENT STONE, COMPLETE IN PLACE AS SHOWN ON THE DRAWINGS.  
  
INCLUDES FURNISHING AND PLACING CLASS E REVETMENT STONE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS EXCEPT THAT THE MAXIMUM STONE SIZE SHALL BE 400 POUNDS AND A MINIMUM OF 50% OF THE MATERIAL SHALL BE GREATER THAN 150 POUNDS.  
  
REVETMENT STONE SHALL BE SCREENED PRIOR TO HAULING BY RUNNING THE STONE THROUGH A GRIZZLY OR PLATE SCREEN WITH A MINIMUM OPENING SIZE OF 8 INCHES. THIS OPERATION SHALL BE DONE AT THE QUARRY. THE PORTION OF THE STONE THAT IS REMOVED BY SCREENING WILL NOT BE ACCEPTABLE FOR USE AS REVETMENT STONE.
7. INCLUDES RESTORING ALL DISTURBED AREAS IN ACCORDANCE WITH SECTION 2601 OF THE REFERENCE SPECIFICATIONS EXCEPT THAT THE FOLLOWING SPECIES AND RATE OF SEED SHALL BE SOWN PER ACRE:  
  
SWITCHGRASS (CAVE-IN-ROCK) 3 POUNDS (PLS)  
SMOOTH BROMEGRASS (SOUTHERN TYPE) 15 POUNDS  
TALL FESCUE (ENDOPHYTE FREE) 12 POUNDS  
RED CLOVER (MEDIUM) 5 POUNDS  
BIRDSFOOT TREFOIL (EMPIRE) 5 POUNDS  
PERENNIAL RYEGRASS 10 POUNDS  
  
AT THE OPTION OF THE ENGINEER, 1 1/2 BUSHEL PER ACRE OF OATS MAY BE SEEDDED AS A NURSE CROP. THIS DECISION WILL BE BASED ON THE STEEPNESS OF THE SLOPES AND THE NEED FOR IMMEDIATE COVER.  
SECTION 1109.16 PARAGRAPH C.2 OF THE REFERENCE SPECIFICATIONS DOES NOT APPLY.
8. SEE CONSTRUCTION SPECIFICATIONS FOR MATERIAL AND INSTALLATION DETAILS ON SHEET B.01.
9. THIS ITEM CONSIST OF DIVERTING SURFACE WATER AND DEWATERING THE SITE AS NEEDED FOR CONSTRUCTION. POLLUTION CONTROL SHALL BE INCLUDED IN AND CONSIDERED INCIDENTAL TO THIS ITEM.




SUNDQUIST ENGINEERING, P.C.  
CONSULTING ENGINEERS  
HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING  
120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442  
PHONE: (712)263-8118 FAX: (712)263-2181

PROJECT NO.:	0506	DATE:	8/96	REV:	
CLIENT:	CRAWFORD COUNTY, IOWA				
DRAWN BY:	TKK	REVIEWED BY:		APPROVED BY:	PJA
DESCRIPTION:	ESTIMATED PROJECT QUANTITIES & GENERAL INFORMATION				SHEET
	PROJ. NO. DS-24(4)				C.01

4-84-41

9-84-41

3-84-41

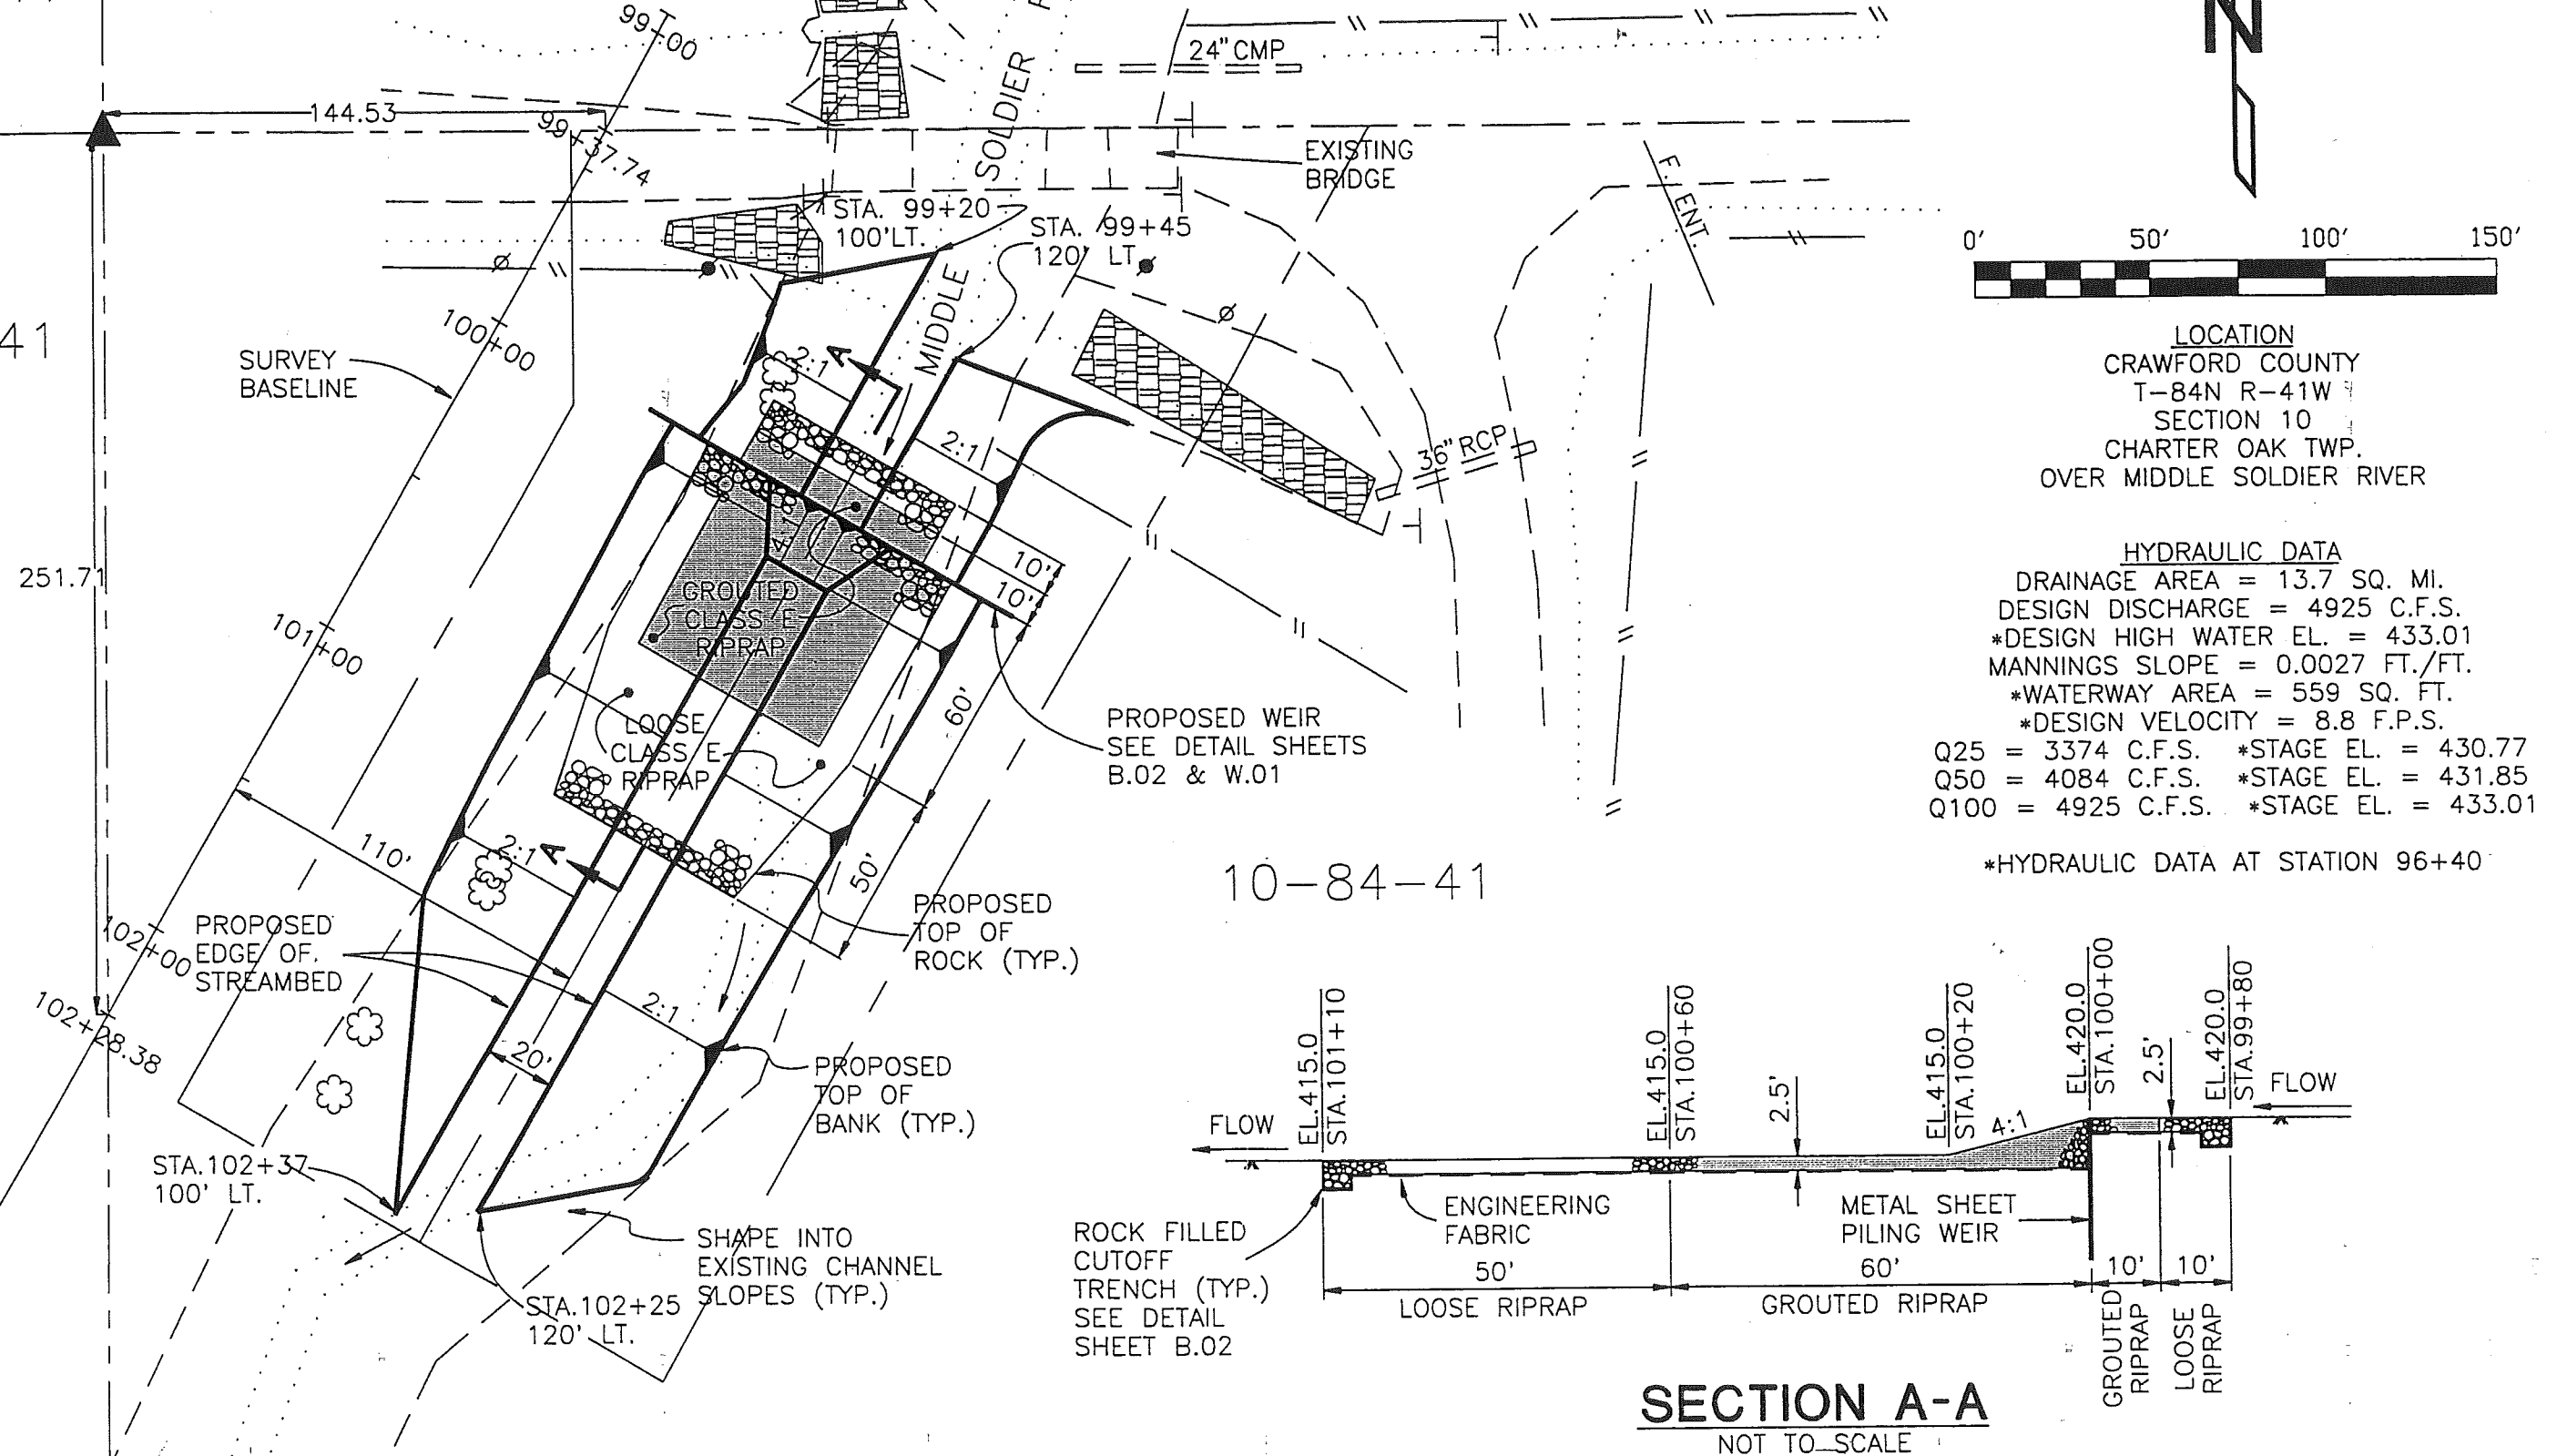

BM#2 - RR SPK IN POWER POLE @  
STA. 99+85.11, 7.82' RT.  
EL. = 437.96



SUNDQUIST ENGINEERING, P.C.


CONSULTING ENGINEERS


HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING

120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442  
PHONE: (712)263-8118 FAX: (712)263-2181

PROJECT NO.:	0506	DATE:	6/96	REV:	
CLIENT:	CRAWFORD COUNTY, IOWA				
DRAWN BY:	TKK	REVIEWED BY:		APPROVED BY:	PJA
DESCRIPTION:	PLAN VIEW				
	PROJ. NO. DS-24(4)				
					SHEET
					D.01



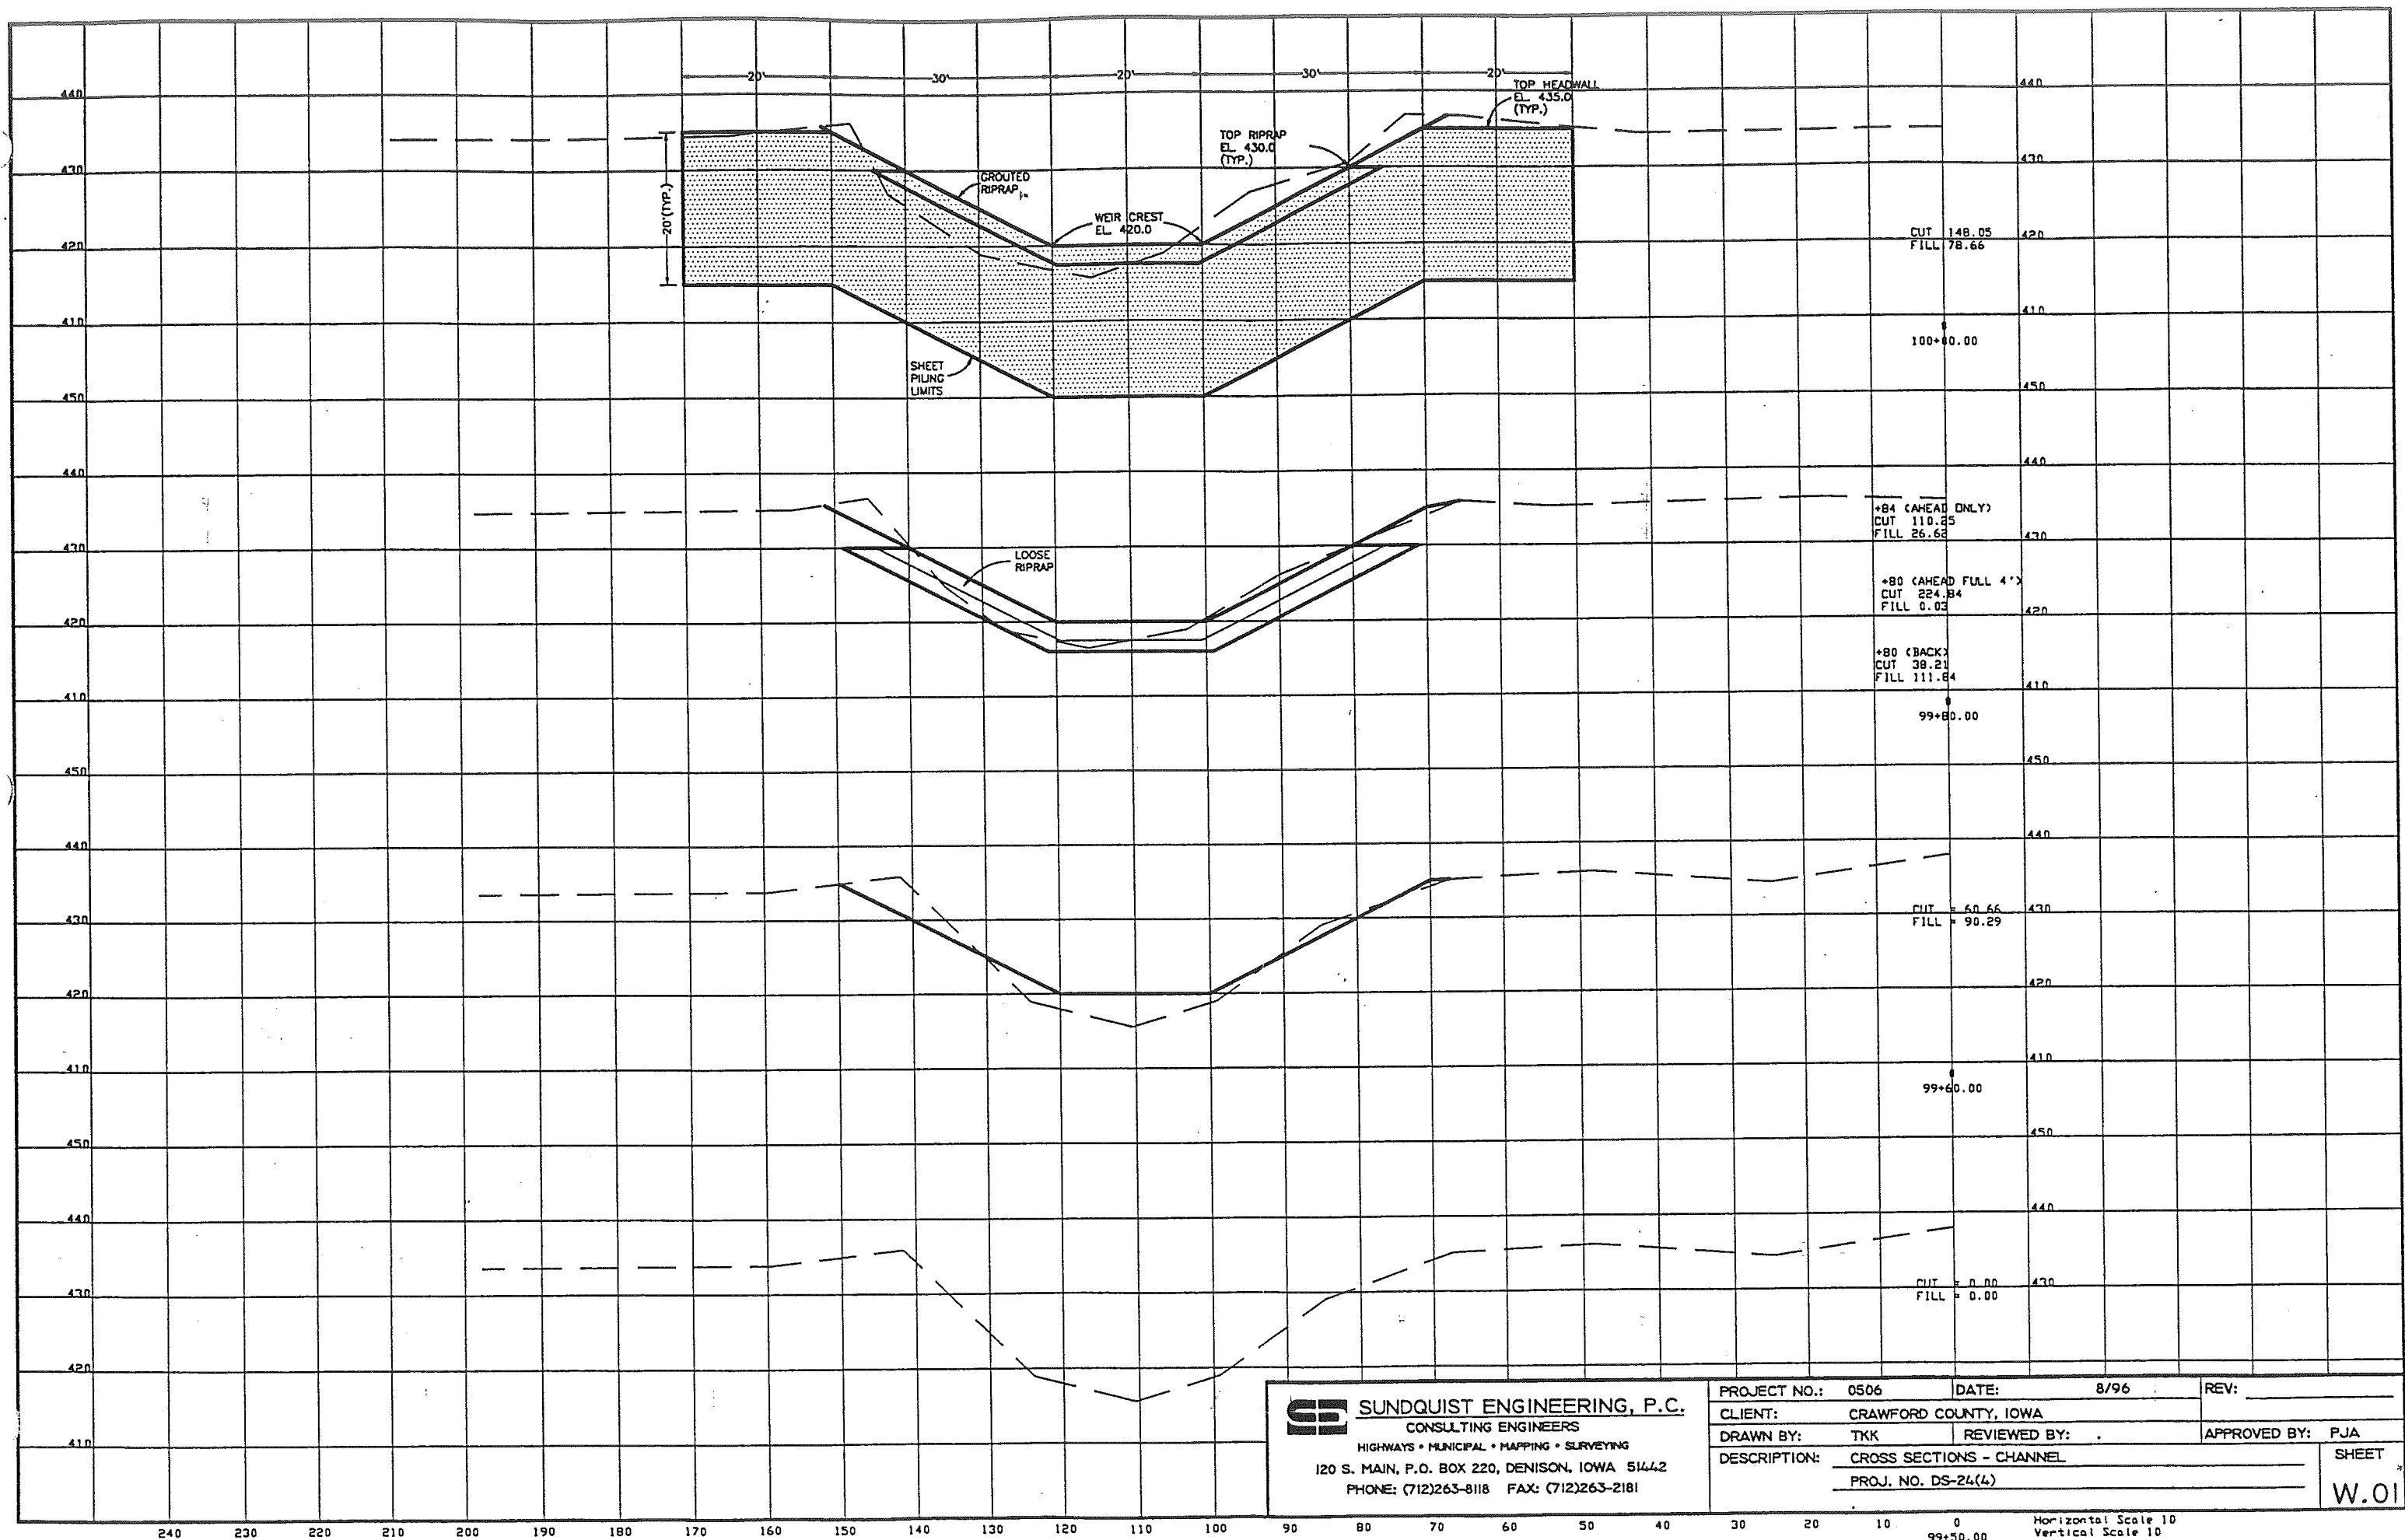


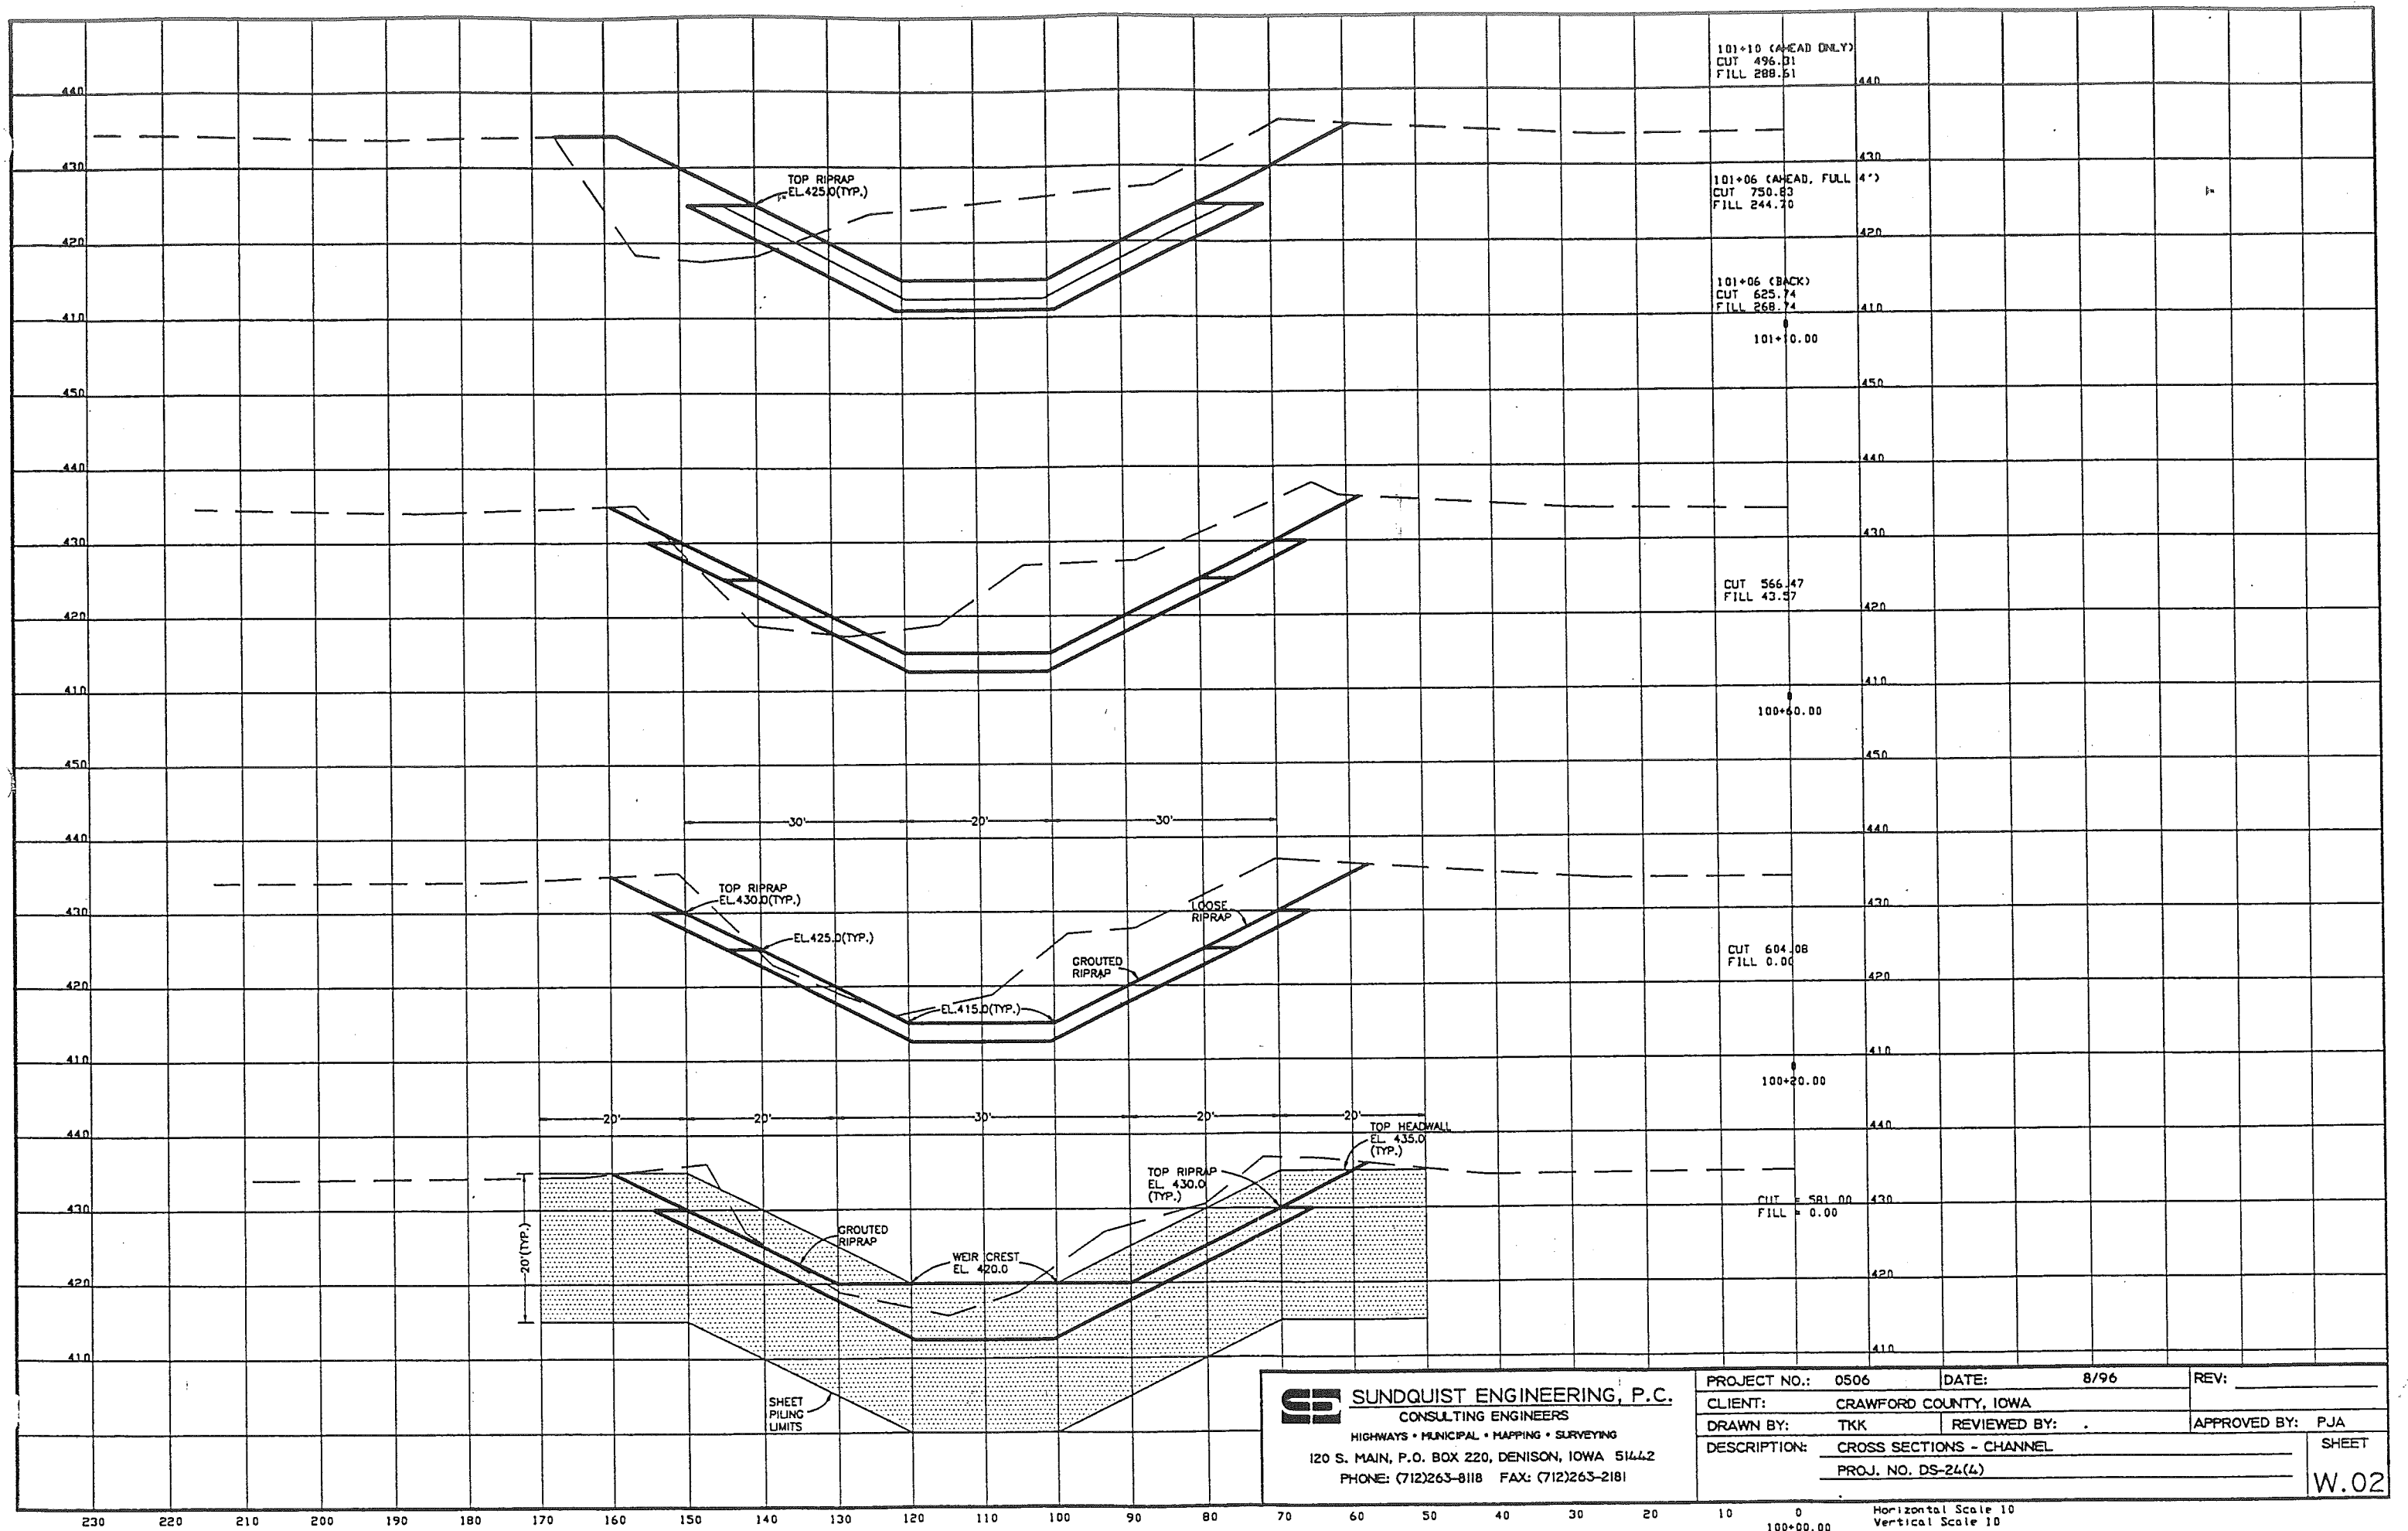


**SUNDQUIST ENGINEERING, P.C.**  
CONSULTING ENGINEERS  
HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING  
120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442  
PHONE: (712)263-8118 FAX: (712)263-2181

PROJECT NO.:	0506	DATE:	8/96	REV:	
CLIENT:	CRAWFORD COUNTY, IOWA				
DRAWN BY:	TKK	REVIEWED BY:		APPROVED BY:	PJA
DESCRIPTION:	CROSS SECTIONS - CHANNEL				SHEET
	PROJ. NO. DS-24(4)				W.02



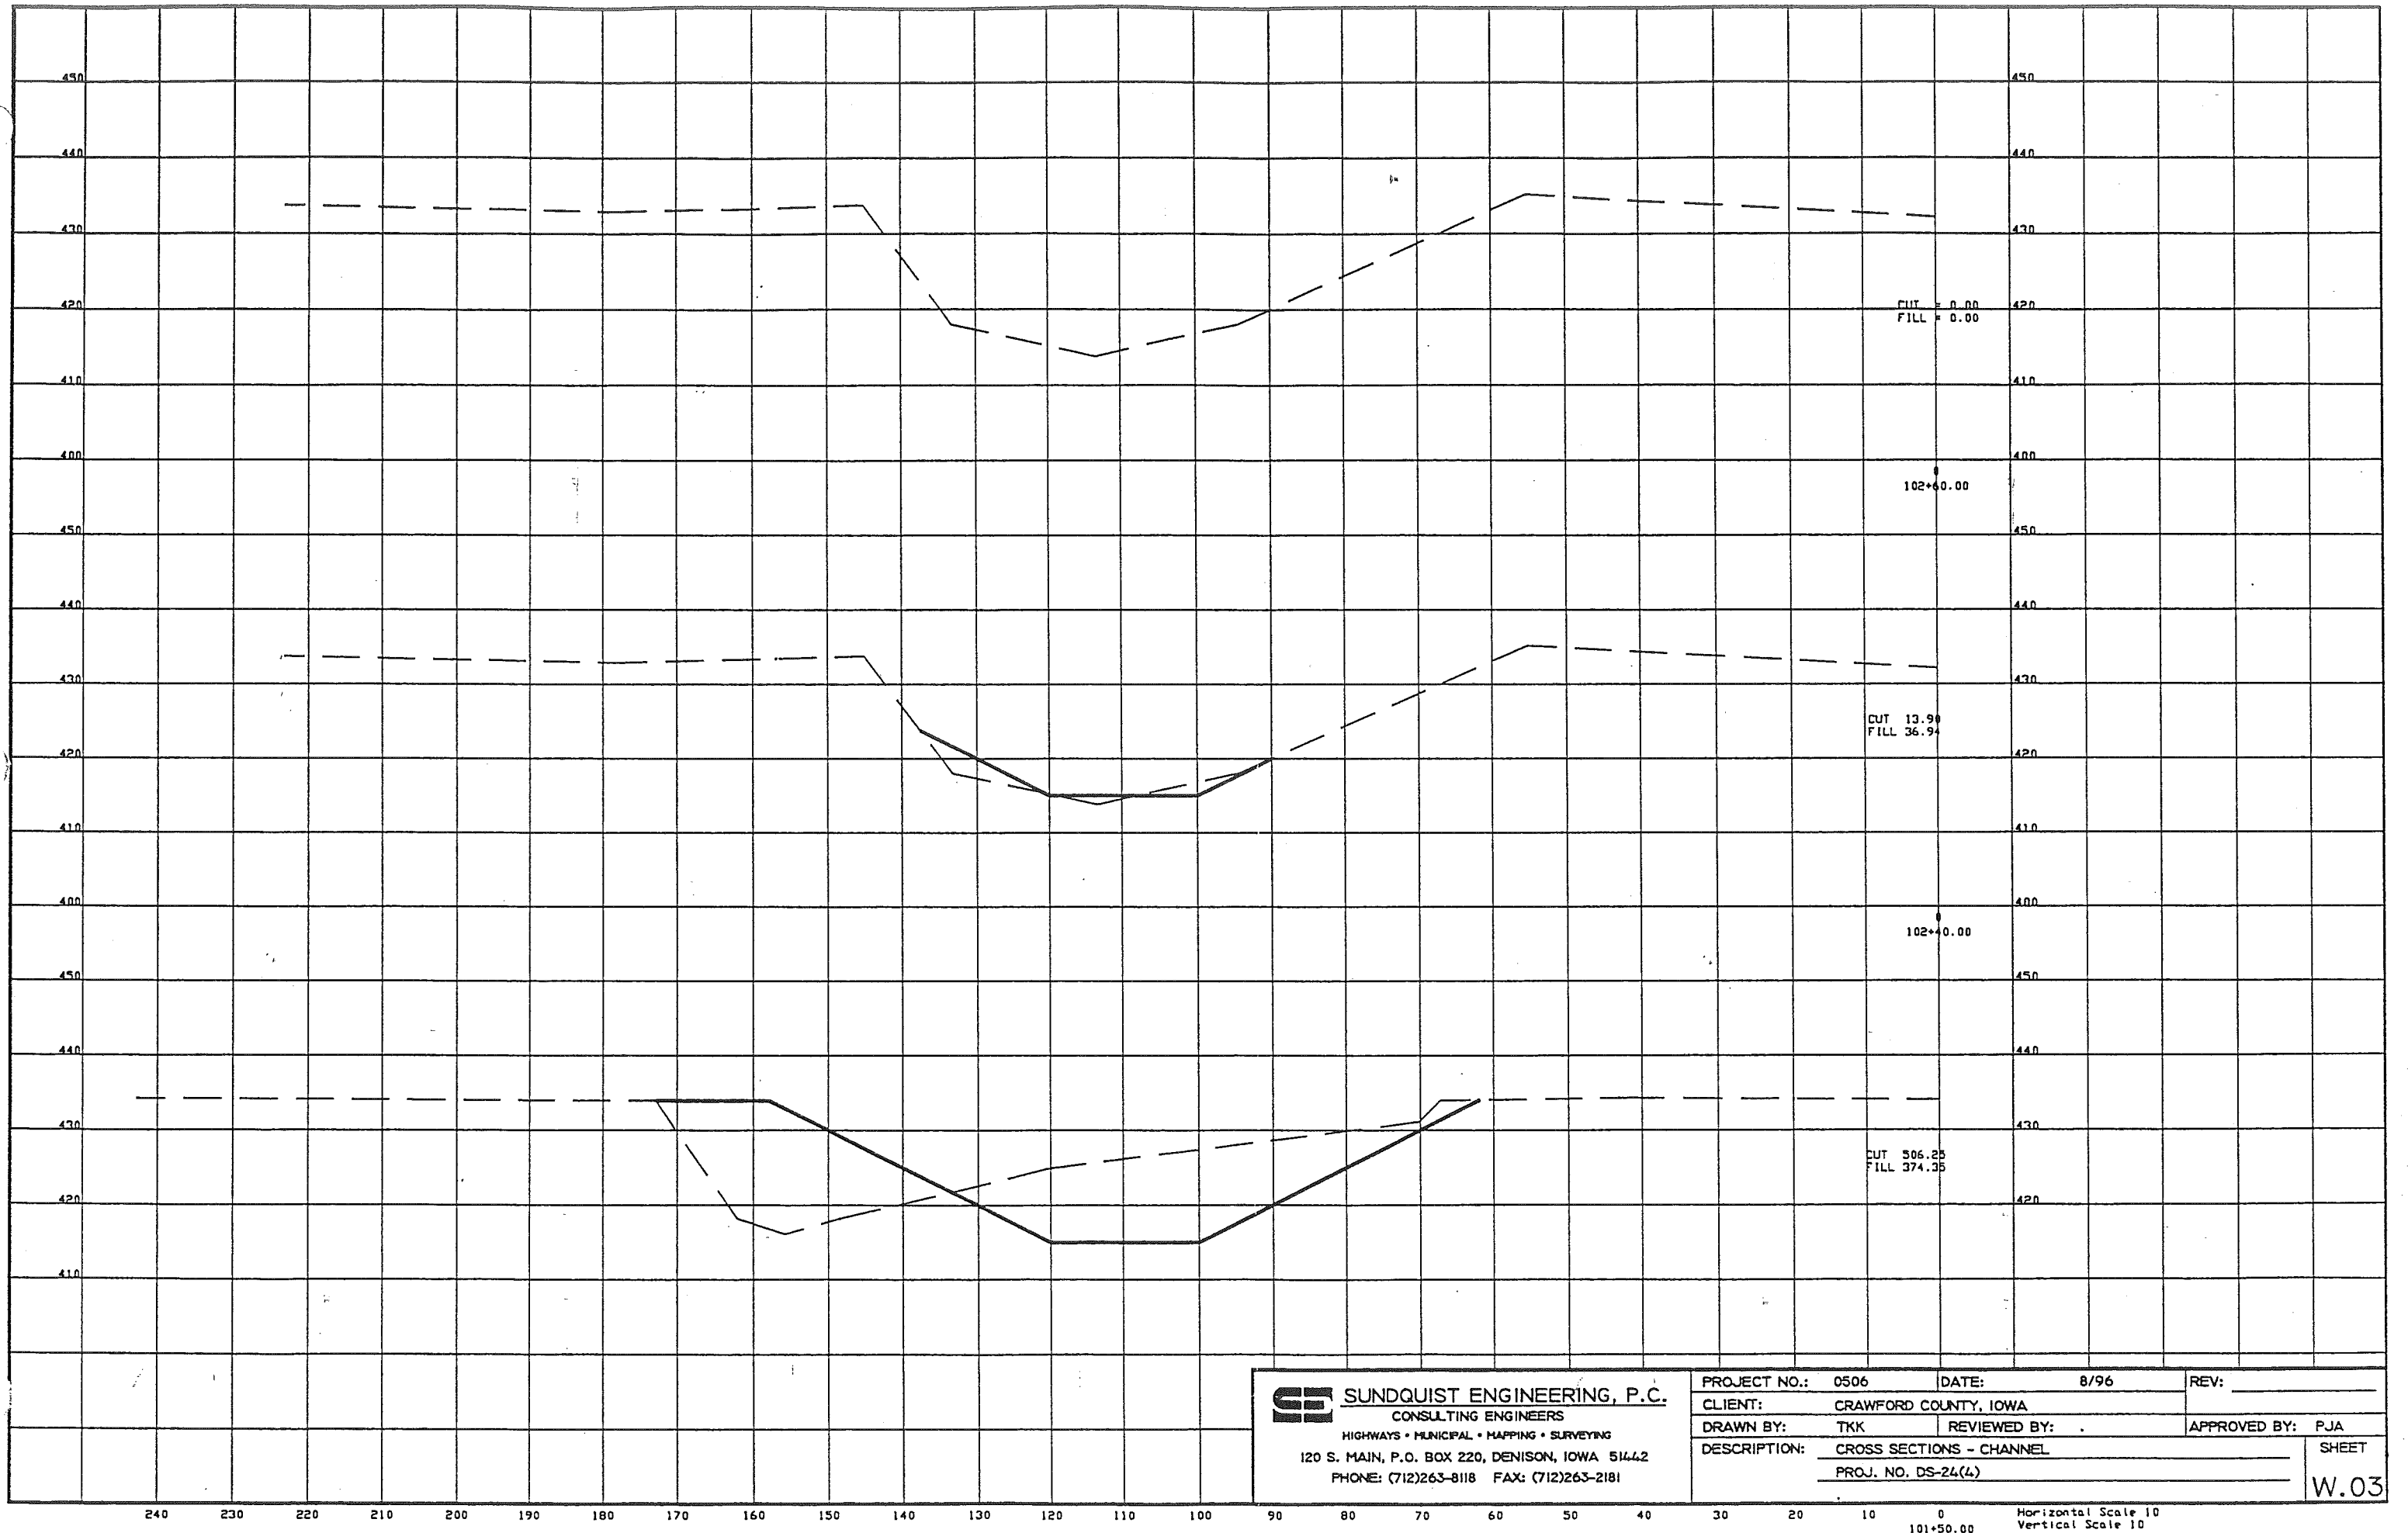

 <b>SUNDQUIST ENGINEERING, P.C.</b> CONSULTING ENGINEERS HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING 120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442 PHONE: (712)263-8118 FAX: (712)263-2181	PROJECT NO.: 0506	DATE: 8/96	REV: _____
	CLIENT: CRAWFORD COUNTY, IOWA		
	DRAWN BY: TTK	REVIEWED BY: _____	APPROVED BY: PJA
	DESCRIPTION: CROSS SECTIONS - CHANNEL		SHEET
	PROJ. NO. DS-24(4)		W.03