

441

2538-JAN

CRAWFORD COUNTY PROJECT NO. FM-24(45)--55-24

Letting Date JUNE 2, 1998

RIPRAP

#### ARCHAEOLOGICAL

IF ARCHAEOLOGICAL MATERIALS ARE ENCOUNTERED DURING THE CONSTRUCTION PHASE OF THIS PROJECT, THE ENGINEER MUST BE CONTACTED IMMEDIATELY SO THE PROPER AUTHORITIES CAN BE NOTIFIED ACCORDING TO THE EXISTING FEDERAL REGULATIONS AND STATE PROCEDURES. ADDITIONALLY, IT SHOULD BE NOTED THAT FINDINGS AND RECOMMENDATIONS FOR CLEARANCE FOR FURTHER TESTING CANNOT BE CONSIDERED FINAL UNTIL CONCURRENCE IS RECEIVED FROM THE OFFICE OF THE STATE HISTORIC PRESERVATION OFFICER.

#### TRAFFIC CONTROL PLAN

THROUGH TRAFFIC WILL BE MAINTAINED AT ALL TIMES DURING CONSTRUCTION. LOCAL TRAFFIC TO ADJACENT PROPERTIES WILL BE MAINTAINED AS PROVIDED FOR IN ARTICLE 1107.08 OF THE CURRENT STANDARD SPECIFICATIONS. TRAFFIC CONTROL DEVICES, PROCEDURES AND LAYOUTS SHALL BE AS PER PART VI OF THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) REVISION 3, DATED SEPTEMBER 3, 1993.

#### PERMITS

THIS PROJECT IS COVERED BY THE CORPS OF ENGINEERS NATIONWIDE PERMIT NO.S 13 AND 26. AND IOWA DEPARTMENT OF NATURAL RESOURCES FLOOD PLAIN DEVELOPMENT PERMIT NO. FP97-283.

## IOWA DEPARTMENT OF TRANSPORTATION

Project Development Division  
PLANS OF PROPOSED IMPROVEMENT ON THE

# FARM TO MARKET ROAD SYSTEM CRAWFORD COUNTY

## STREAM CHANNEL STABILIZATION STRUCTURE - RIPRAP PROJECT NO. FM-24(45)--55-24

Proj. No. FM-24(45)--55-24

#### INDEX OF SHEETS

NO.	DESCRIPTION
A1	TITLE SHEET
B1	ESTIMATED PROJECT QUANTITIES AND GENERAL INFORMATION
C1	CONSTRUCTION SPECIFICATIONS
C2-3	TYPICAL SECTIONS
D1	PLAN VIEW
W1-6	CROSS SECTIONS


The Iowa Department of Transportation Standard Specifications for Highway and Bridge Construction, series of 1997, plus current Supplemental Specifications and Special Provisions shall apply to construction work on this project.

Scales: As Noted

#### ROAD STANDARD PLANS

The following Standard Plans shall be considered applicable to construction work on this project.


Identification	Date	Identification	Date	Identification	Date
RS-2	4-30-96	RS-3	12-3-96		

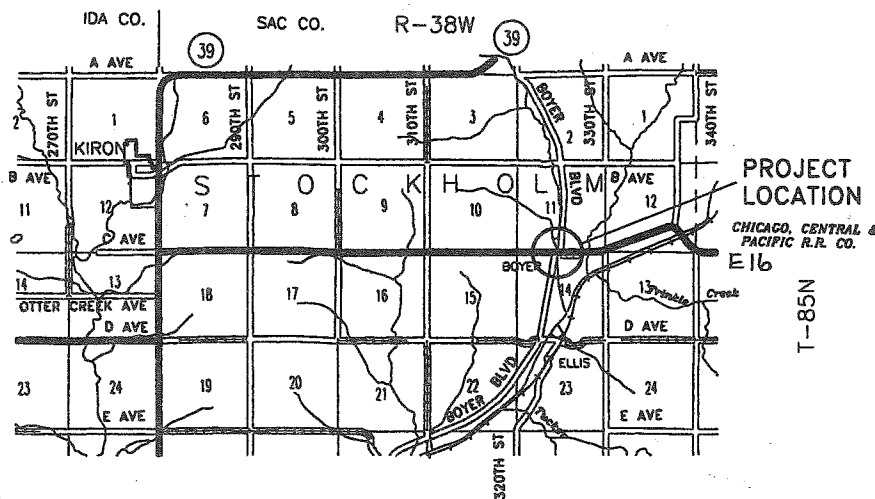

#### LOCATION MAP



1996 AADT 90-460 V.P.D.



I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF IOWA.

*Paul J. Assman* 1/2/98  
PAUL J. ASSMAN, P.E. #11982 DATE

MY LICENSE RENEWAL DATE IS DECEMBER 31, 1998.  
PAGES OR SHEETS COVERED BY THIS SEAL: ALL SHEETS

Approved  
*H. Dean Burgess*  
*William J. Jackson*  
*Robert A. Johnson*  
*John P. Hawley*  
*Mark Sigler*  
BOARD OF SUPERVISORS

Approved  
*H. Dale Wright* 1-6-98  
Crawford County Engineer Date

Iowa Department of Transportation  
Accepted for Letting  
*Philip D. Buchanan*  
SECONDARY ROADS ENGINEER Date

Design No.:

File No.:

Crawford County Proj. No. (FM-24(45))--55-24

Sheet No. A1

GENERAL NOTES

IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO MAKE ALL NECESSARY ARRANGEMENTS WITH ADJACENT PROPERTY OCCUPANTS FOR RESTRAINING LIVESTOCK FROM ENTERING THE RIGHT OF WAY.

CONTRACTOR IS TO USE DUE CAUTION IN WORKING OVER AND AROUND ALL TILE LINES. BREAKS IN THE TILE LINE DUE TO THE CONTRACTOR'S CARELESSNESS ARE TO BE REPLACED AT HIS EXPENSE WITHOUT COST TO THE COUNTY. ANY TILE LINES BROKEN OR DISTURBED BY CUT LINES WILL BE REPLACED AS DIRECTED BY THE ENGINEER IN CHARGE OF CONSTRUCTION AND AT THE COUNTY'S EXPENSE.

ALL BORROW AREAS, STOCKPILE AREAS, HAUL ROADS AND AREAS FOR MANEUVERING EQUIPMENT ON THIS PROJECT WILL REQUIRE SUBSOIL TILLAGE TO AN AVERAGE DEPTH OF 18 TO 24 INCHES. SUCH TILLAGE SHALL BE ACCOMPLISHED ON MAXIMUM OF THREE FOOT CENTERS. SUCH AREAS SHALL BE DESIGNATED BY THE COUNTY ENGINEER.

WHERE PUBLIC UTILITY FIXTURES ARE SHOWN AS EXISTING ON THE PLANS OR ENCOUNTERED WITHIN THE CONSTRUCTION AREA, IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE OWNERS OF THOSE UTILITIES PRIOR TO THE BEGINNING OF ANY CONSTRUCTION. THE CONTRACTOR SHALL AFFORD ACCESS TO THESE FACILITIES FOR NECESSARY MODIFICATION OF SERVICES. UNDERGROUND FACILITIES, STRUCTURES AND UTILITIES HAVE BEEN PLOTTED FROM AVAILABLE SURVEYS AND RECORDS, AND THEREFORE THEIR LOCATIONS MUST BE CONSIDERED APPROXIMATE ONLY. IT IS POSSIBLE THERE MAY BE OTHERS, THE EXISTENCE OF WHICH IS PRESENTLY NOT KNOWN OR SHOWN. IT IS THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THEIR EXISTENCE AND EXACT LOCATION AND TO AVOID DAMAGE THERETO. NO CLAIMS FOR ADDITIONAL COMPENSATION WILL BE ALLOWED TO THE CONTRACTOR FOR ANY INTERFERENCE OR DELAY CAUSED BY SUCH WORK.

CONTRACTOR SHALL NOTIFY ONE-CALL (1-800-292-8989) FOR UTILITY LOCATES PRIOR TO COMMENCING WORK.

202-1  
THE CONTRACTOR'S ATTENTION IS DIRECTED TO THE FACT THAT ARCHAEOLOGICAL REMAINS MAY BE UNCOVERED ON THIS PROJECT. REFER TO SECTION 2102.10 OF THE STANDARD SPECIFICATIONS. THE ENGINEER SHALL NOTIFY BOTH THE OFFICE OF THE STATE ARCHAEOLOGIST IN IOWA CITY AND THE OFFICE OF PROJECT PLANNING, IOWA DOT A MINIMUM OF ONE WEEK PRIOR TO THE EXPECTED DATE OF THE START OF CONSTRUCTION ACTIVITIES.

213-1  
IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE WASTE AREAS OR DISPOSAL SITES FOR EXCESS MATERIAL (EXCAVATED MATERIAL, OPEN DUMP REFUSE OR BROKEN CONCRETE) WHICH IS NOT DESIRABLE TO BE INCORPORATED INTO THE WORK INVOLVED ON THIS PROJECT. NO PAYMENT FOR OVERHAUL WILL BE ALLOWED FOR MATERIAL HAULED TO THESE SITES. NO MATERIAL SHALL BE PLACED WITHIN THE RIGHT OF WAY, UNLESS SPECIFICALLY STATED IN THE PLANS OR APPROVED BY THE ENGINEER.

251-1  
THE CONTRACTOR SHALL BE RESPONSIBLE TO MAINTAIN ACCESS TO INDIVIDUAL PROPERTIES DURING CONSTRUCTION.

RELOCATED ACCESS SHALL BE COMPLETED TO INDIVIDUAL PROPERTIES PRIOR TO REMOVAL OF EXISTING ACCESS.

IF THE PERMANENT ACCESS CANNOT BE COMPLETED PRIOR TO REMOVAL OF THE EXISTING ACCESS, THE CONTRACTOR SHALL PROVIDE AND MAINTAIN AN ALTERNATE ACCESS. TEMPORARY GRANULAR SURFACING WILL BE PAID FOR AS A CONTRACT ITEM OR BY EXTRA WORK.

ESTIMATE REFERENCE INFORMATION

DATA LISTED BELOW IS FOR INFORMATIONAL PURPOSES ONLY AND SHALL NOT CONSTITUTE A BASIS FOR ANY EXTRA WORK ORDERS.

1. CLEARING AND GRUBBING  
INCLUDES REMOVAL AND DISPOSAL OF TREES, DOWN TIMBER, LOGS, DRIFTS, DEBRIS AND OTHER OBSTRUCTIONS LYING WITHIN AND ADJACENT TO THE PORTER CREEK CHANNEL FROM STA. 50+50 TO STA. 57+00 AND THE SIDE CHANNEL FROM PORTER CREEK TO THE EXISTING RCB CULVERT.

ITEM ALSO INCLUDES REMOVAL AND DISPOSAL OF OPEN DUMP MATERIAL LOCATED WITHIN THE STREAM CHANNEL BETWEEN STATIONS 51+00 AND 52+00 ALL IN ACCORDANCE WITH LOCAL, STATE AND FEDERAL REGULATIONS.

2. EMBANKMENT-IN-PLACE  
INCLUDES THE FOLLOWING QUANTITIES AS ESTIMATED FROM THE CROSS SECTIONS.

FILL + 35% SHRINKAGE = 2235 C.Y.

TYPE "A" COMPACTION WILL BE REQUIRED. BORROW FROM SUITABLE CLASS 10 CHANNEL EXCAVATION ALLOWED. ADDITIONAL NECESSARY BORROW SHALL BE PROVIDED BY THE CONTRACTOR. NO PAYMENT FOR OVERHAUL WILL BE ALLOWED. ALL AREAS TO RECEIVE NEW EMBANKMENT SHALL BE THOROUGHLY CLEAN OF ALL VEGETATION AND OTHER DEBRIS. EXISTING SURFACES SHALL BE PLOWED, STEPPED OR BENCHED PRIOR TO PLACEMENT OF NEW EMBANKMENT FILLS. SUCH WORK SHALL BE INCLUDED IN AND CONSIDERED INCIDENTAL TO THIS ITEM. PAYMENT FOR THIS ITEM SHALL BE AT PLAN QUANTITY.

FILL MATERIALS SHALL CONTAIN NO SOD, BRUSH, ROOTS OR OTHER PERISHABLE MATERIALS. FILL SHALL NOT BE PLACED UPON A FROZEN SURFACE, NOR SHALL SNOW, ICE OR FROZEN MATERIAL BE INCORPORATED IN THE FILL.

SHAPING OF THE EXISTING CHANNEL BOTTOMS AND SIDESLOPES AND ROAD DITCHES AS DIRECTED BY THE ENGINEER TO TRANSITION INTO THE PROPOSED IMPROVEMENTS SHALL BE INCLUDED IN AND CONSIDERED INCIDENTAL TO THE PRICE BID FOR EMBANKMENT-IN-PLACE.

3. EXCAVATION, CLASS 10 CHANNEL  
SUITABLE CLASS 10 CHANNEL EXCAVATION MAY BE USED FOR EMBANKMENT-IN-PLACE. EXCESS MATERIALS AND UNSUITABLE MATERIAL SHALL BE HAULED FROM THE SITE AND DISPOSED OF BY THE CONTRACTOR. THE COST OF HAULING AND DISPOSING OF THIS MATERIAL SHALL BE INCLUDED IN AND CONSIDERED INCIDENTAL TO THE PRICE BID FOR CLASS 10 CHANNEL EXCAVATION.

PAYMENT SHALL BE BASED ON PLAN QUANTITY.

4. PILING, STEEL SHEET  
THIS ITEM SHALL CONSIST OF FURNISHING AND INSTALLING THE SHEET PILING AND WATER AS SHOWN ON THE DRAWINGS. THIS ITEM SHALL INCLUDE FIELD CUTTING THE SHEET PILING TO THE SPECIFIED 2:1 GRADE AS SHOWN ON THE DRAWINGS.

THE SHEET PILING AND APPURTENANT METALWORK SHALL MEET THE REQUIREMENTS OF ASTM A328, A572 OR A690. THE SHEET PILING SHALL BE INSTALLED STARTING FROM THE CENTERLINE OF THE WEIR SECTION AND PROGRESSING AWAY FROM THE CENTERLINE.

SHEET PILING SHALL MEET THE FOLLOWING REQUIREMENTS:

- (a) MINIMUM SECTION MODULUS OF 19.25 CU. IN. PER FOOT OF LENGTH  
(b) MINIMUM WALL THICKNESS OF 3/8 INCH.

5. ENGINEERING FABRIC  
SEE DRAWING SHEET C2 DETAILS OF PLACEMENT OF ENGINEERING FABRIC FOR INSTALLATION DETAILS. MATERIAL TO CONFORM TO IOWA DOT MATERIALS IM 496.01 APPENDIX A, EMBANKMENT EROSION CONTROL (SPECIFICATION 4196.01C).

6. REVENTMENT, CLASS E, RIPRAP  
THIS ITEM SHALL CONSIST OF FURNISHING AND PLACING REVETMENT STONE, COMPLETE IN PLACE AS SHOWN ON THE DRAWINGS.

INCLUDES FURNISHING AND PLACING CLASS E REVETMENT STONE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS EXCEPT THAT THE MAXIMUM STONE SIZE SHALL BE 400 POUNDS AND A MINIMUM OF 50% OF THE MATERIAL SHALL BE GREATER THAN 150 POUNDS.

REVTMENT STONE SHALL BE SCREENED PRIOR TO HAULING BY RUNNING THE STONE THROUGH A GRIZZLY OR PLATE SCREEN WITH A MINIMUM OPENING SIZE OF 8 INCHES. THIS OPERATION SHALL BE DONE AT THE QUARRY. THE PORTION OF THE STONE THAT IS REMOVED BY SCREENING WILL NOT BE ACCEPTABLE FOR USE AS REVETMENT STONE.

ESTIMATED PROJECT QUANTITIES

ITEM NO.	ITEM CODE	ITEM	UNIT	TOTAL	AS BUILT QUAN.
1	2101-0850002	CLEARING AND GRUBBING	UNIT	512	
2	2102-2625000	EMBANKMENT-IN-PLACE	CY	2235	
3	2104-2710020	EXCAVATION, CLASS 10 CHANNEL	CY	3932	
4	2501-5775000	PILING, STEEL SHEET	SF	2360	
5	2507-3250005	ENGINEERING FABRIC	SY	2093	
6	2507-6800060	REVTMENT, CLASS E, RIPRAP	TON	2242	
7	2528-8445110	TRAFFIC CONTROL	LS	LS	
8	2533-4980005	MOBILIZATION	LS	LS	
9	2601-2634100	MULCHING	ACRE	2	
10	2601-2636041	SEEDING AND FERTILIZING	ACRE	2	
11	2599-9999003	GROUT	CY	106	
12	2599-9999010	REMOVAL OF WATER	LS	LS	
13	2528-8445112	FLAGGERS	DAY	5	

THE CONTRACTOR WILL BE RESPONSIBLE FOR REMOVAL OF ALL REMNANTS OF RIPRAP STOCKPILES FROM FARM FIELDS UTILIZED BY CONTRACTOR IN THE PROJECT AREA. THIS WORK WILL BE INCLUDED IN AND CONSIDERED INCIDENTAL TO THE PRICE BID FOR THIS ITEM.

7. TRAFFIC CONTROL  
INCLUDES BARRICADES AND WARNING SIGNS NECESSARY TO PROTECT THE CONTRACTORS WORK AND EQUIPMENT AND THE SAFETY OF THE TRAVELING PUBLIC. ALL SIGNS, BARRICADES AND OTHER TRAFFIC CONTROL DEVICES SHALL BE IN ACCORDANCE WITH THE "MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES FOR STREETS AND HIGHWAYS" 1988.

9. MULCHING  
10. SEEDING AND FERTILIZING  
INCLUDES RESTORING ALL DISTURBED AREAS IN ACCORDANCE WITH SECTION 2601 OF THE REFERENCE SPECIFICATIONS EXCEPT THAT THE FOLLOWING SPECIFIED SPECIES AND RATE OF SEED SHALL BE SOWN PER ACRE:

SWITCHGRASS (CAVE-IN-ROCK)	3 POUNDS (PLS)
SMOOTH BROMEGRASS (SOUTHERN TYPE)	15 POUNDS
TALL FESCUE (ENDOPHYTE FREE)	12 POUNDS
RED CLOVER (MEDIUM)	5 POUNDS
BIRDSFOOT TREFOIL (EMPIRE)	5 POUNDS
PERENNIAL RYEGRASS	10 POUNDS

AT THE OPTION OF THE ENGINEER, 1 1/2 BUSHELS PER ACRE OF OATS MAY BE SEEDED AS A NURSE CORP. THIS DECISION WILL BE BASED ON THE STEEPNESS OF THE SLOPES AND THE NEED FOR IMMEDIATE COVER. SECTION 1109.16 PARAGRAPH C OF THE REFERENCE SPECIFICATIONS DOES NOT APPLY.

11. GROUT  
SEE CONSTRUCTION SPECIFICATIONS ON SHEET C1 FOR MATERIAL AND INSTALLATION DETAILS.

12. REMOVAL OF WATER  
THIS ITEM CONSIST OF DIVERTING SURFACE WATER AND DEWATERING THE SITE AS NEEDED FOR CONSTRUCTION. POLLUTION CONTROL SHALL BE INCLUDED IN AND CONSIDERED INCIDENTAL TO THIS ITEM.

DEWATERING OF SITE SHALL INCLUDE REMOVAL OF WATER FROM THE PROPOSED STILLING BASIN TO FACILITATE PLACEMENT OF ENGINEERING FABRIC, RIPRAP AND GROUT. PLACEMENT OF GROUT IN STANDING WATER SHALL NOT BE ALLOWED.



**SUNDQUIST ENGINEERING, P.C.**  
CONSULTING ENGINEERS  
HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING  
120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442  
PHONE: (712)263-8118 FAX: (712)263-2181

PROJECT NO.:	0547	DATE:	7/97	REV:	
CLIENT:	CRAWFORD COUNTY, IOWA				
DRAWN BY:	TKK	REVIEWED BY:		APPROVED BY:	PJA
DESCRIPTION:	ESTIMATED PROJECT QUANTITIES & GENERAL INFORMATION				SHEET
					BI

# CONSTRUCTION SPECIFICATIONS

## CONCRETE GROUT

### 1. SCOPE

THE WORK SHALL CONSIST OF FURNISHING, TRANSPORTING, AND PLACING CONCRETE GROUT IN THE CONSTRUCTION OF GROUTED ROCK RIPRAP SECTIONS SHOWN ON THE DRAWINGS.

### 2. MATERIALS

**PORTLAND CEMENT** SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M 85, TYPE 1.

**POZZOLAN**, UNLESS OTHERWISE SPECIFIED IN SECTION 10 OF THIS SPECIFICATION, POZZOLANS CONFORMING TO SPECIFICATION ASTM C-618 CLASS F IN AMOUNTS NOT TO EXCEED 20 PERCENT, BASED ON ABSOLUTE VOLUME, MAY BE SUBSTITUTED FOR AN EQUIVALENT AMOUNT OF PORTLAND CEMENT IN THE GROUT MIXTURE.

**AGGREGATES** SHALL CONFORM TO THE REQUIREMENTS OF ASTM SPECIFICATION C-33.

**WATER** SHALL BE CLEAN AND FREE FROM INJURIOUS AMOUNTS OF OILS, ACID, ALKALI, ORGANIC MATTER OR OTHER DELETERIOUS SUBSTANCES.

**AIR-ENTRAINING** ADMIXTURES SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M 154.

**CURING** COMPOUND SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M 148.

**OTHER ADMIXTURES**, WHEN REQUIRED, SHALL BE AS SPECIFIED IN THE CONSTRUCTION DETAILS.

### 3. DESIGN OF THE GROUT MIX

THE MIX PROPORTIONS FOR THE GROUT MIX SHALL BE AS SPECIFIED IN THE CONSTRUCTION DETAILS. DURING THE COURSE OF THE WORK THE ENGINEER WILL REQUIRE ADJUSTMENT OF THE MIX PROPORTIONS WHENEVER NECESSARY. AFTER THE MIX HAS BEEN DESIGNATED, IT SHALL NOT BE CHANGED WITHOUT THE APPROVAL OF THE ENGINEER.

### 4. HANDLING AND MEASUREMENT OF MATERIAL

MATERIALS SHALL BE STOCKPILED AND BATCHED BY METHODS THAT WILL PREVENT SEGREGATION OR CONTAMINATION OF AGGREGATES AND INSURE ACCURATE PROPORTIONING OF THE INGREDIENTS OF THE MIX.

EXCEPT AS OTHERWISE PROVIDED IN SECTION 8, CEMENT AND AGGREGATES SHALL BE MEASURED AS FOLLOWS:

**CEMENT** SHALL BE MEASURED BY WEIGHT OR IN BAGS OF 94 POUNDS EACH. WHEN CEMENT IS MEASURED IN BAGS, NO FRACTION OF A BAG SHALL BE USED UNLESS WEIGHED.

**AGGREGATES** SHALL BE MEASURED BY WEIGHT. MIX PROPORTIONS SHALL BE BASED ON SATURATED, SURFACE-DRY WEIGHTS. THE BATCH WEIGHT OF EACH AGGREGATE SHALL BE THE REQUIRED SATURATED, SURFACE-DRY WEIGHT PLUS THE WEIGHT OF SURFACE MOISTURE IT CONTAINS.

**WATER** SHALL BE MEASURED BY VOLUME OR BY WEIGHT, TO AN ACCURACY WITHIN ONE PERCENT OF THE TOTAL QUANTITY OF WATER REQUIRED FOR THE BATCH.

**ADMIXTURES** SHALL BE MEASURED WITHIN A LIMIT OF ACCURACY OF  $\pm 3$  PERCENT.

### 5. MIXERS AND MIXING

THE MIXER, WHEN LOADED TO CAPACITY, SHALL BE CAPABLE OF COMBINING THE INGREDIENTS OF THE GROUT MIX INTO A THOROUGHLY MIXED AND UNIFORM MASS AND OF DISCHARGING IT WITH A SATISFACTORY DEGREE OF UNIFORMITY.

MIXER SHALL BE OPERATED WITHIN THE LIMITS OF THE MANUFACTURER'S GUARANTEED CAPACITY AND SPEED OF ROTATION.

THE TIME OF MIXING AFTER ALL CEMENT AND AGGREGATES ARE IN THE MIXER DRUM SHALL BE NOT LESS THAN ONE MINUTE FOR MIXERS HAVING A CAPACITY OF ONE CUBIC YARD OR LESS. FOR MIXERS OF LARGER CAPACITIES, THE MINIMUM TIME SHALL BE INCREASED FIFTEEN SECONDS FOR EACH CUBIC YARD OR FRACTION THEREOF OF ADDITIONAL CAPACITY. THE BATCH SHALL BE SO CHARGED INTO THE MIXER THAT SOME WATER WILL ENTER IN ADVANCE OF CEMENT AND AGGREGATE, AND ALL MIXING WATER SHALL BE INTRODUCED INTO THE DRUM BEFORE ONE-FOURTH OF THE MIXING TIME HAS ELAPSED.

WHEN READY-MIXED GROUT MIX IS FURNISHED, THE CONTRACTOR SHALL FURNISH TO THE ENGINEER A DELIVERY TICKET SHOWING THE TIME OF LOADING AND THE QUANTITIES OF MATERIALS USED FOR EACH LOAD OF GROUT MIX.

NO MIXING WATER IN EXCESS OF THE AMOUNT CALLED FOR BY THE JOB MIX SHALL BE ADDED TO THE GROUT MIX DURING MIXING OR HAULING OR AFTER ARRIVAL AT THE DELIVERY POINT.

### 6. CONVEYING AND PLACING

THE GROUT MIX SHALL BE DELIVERED TO THE SITE AND PLACED WITHIN 1-1/2 HOURS AFTER THE INTRODUCTION OF THE CEMENT TO THE AGGREGATES. HOT WEATHER OR UNDER CONDITIONS CONTRIBUTING TO QUICK STIFFENING OF THE CONCRETE, THE TIME BETWEEN THE INTRODUCTION OF THE CEMENT TO THE AGGREGATES AND DISCHARGE SHALL NOT EXCEED 45 MINUTES. THE ENGINEER MAY ALLOW A LONGER TIME, PROVIDED THE SETTING TIME OF THE CONCRETE IS INCREASED A CORRESPONDING AMOUNT BY THE ADDITION OF AN APPROVED SET-RETARDING MIXTURE. IN ANY CASE, CONCRETE SHALL BE CONVEYED FROM THE MIXER TO THE FINAL PLACEMENT AS RAPIDLY AS PRACTICABLE BY METHODS THAT WILL PREVENT SEGREGATION OF THE AGGREGATES OR LOSS OF MORTAR.

GROUT MIX SHALL NOT BE DROPPED MORE THAN 5 FEET VERTICALLY UNLESS SUITABLE EQUIPMENT IS USED TO PREVENT SEGREGATION.

THE GROUT MIX SHALL NOT BE PLACED UNTIL THE ROCK RIPRAP HAS BEEN INSPECTED AND APPROVED BY THE ENGINEER.

ROCK TO BE GROUTED SHALL BE KEPT WET FOR AT LEAST 2 HOURS IMMEDIATELY PRIOR TO GROUTING.

THE ROCK RIPRAP SHALL BE FLUSHED WITH WATER TO REMOVE THE FINES FROM THE ROCK PRIOR TO PLACING THE GROUT. THE ROCK SHALL BE KEPT MOIST JUST AHEAD OF THE ACTUAL PLACING, BUT THE GROUT SHALL NOT BE PLACED IN STANDING OR FLOWING WATER. GROUT PLACED ON INVERTS OR OTHER NEARLY LEVEL AREAS MAY BE PLACED IN ONE COURSE. ON SLOPES, THE GROUT SHALL BE PLACED IN TWO (2) COURSES IN SUCCESSIVE LATERAL STRIPS APPROXIMATELY TEN (10) FEET IN WIDTH STARTING AT THE TOE OF THE SLOPE AND PROGRESSING TO THE TOP. THE GROUT SHALL BE DELIVERED TO THE PLACE OF FINAL DEPOSIT BY APPROVED MEANS AND DISCHARGED DIRECTLY ON THE SURFACE OF THE ROCK, USING A SPLASH PLATE OF METAL OR WOOD TO PREVENT DISPLACEMENT OF THE ROCK DIRECTLY UNDER THE DISCHARGE. THE FLOW OF GROUT SHALL BE DIRECTED WITH BROOMS, SPADES OR BAFFLES TO PREVENT IT FROM FLOWING EXCESSIVELY ALONG THE SAME PATH AND TO ASSURE THAT ALL INTERMITTENT SPACES ARE FILLED. SUFFICIENT BARRING SHALL BE DONE TO LOOSEN TIGHT POCKETS OF ROCK AND OTHERWISE AID THE PENETRATION OF GROUT SO THAT ALL VOIDS SHALL BE FILLED AND THE GROUT FULLY PENETRATES THE ROCK BLANKET. ALL BROOMING ON SLOPES SHALL BE UPHILL AND AFTER THE GROUT HAS STIFFENED, THE ENTIRE SURFACE SHALL BE REBROOMED TO ELIMINATE RUNS AND TO FILL VOIDS CAUSED BY SLOUGHING.

AFTER COMPLETION OF ANY STRIP OR PANEL, NO WORKMAN OR OTHER LOAD SHALL BE PERMITTED ON THE GROUTED SURFACE FOR A PERIOD OF TWENTY FOUR (24) HOURS. THE GROUTED SURFACE SHALL BE PROTECTED FROM INJURIOUS ACTION BY THE SUN, RAIN, FLOWING WATER AND MECHANICAL INJURY.

### 7. CURING AND PROTECTION

THE SURFACE OF TREATMENT MATERIALS SHALL BE PREVENTED FROM DRYING FOR A CURING PERIOD OF AT LEAST 7 DAYS AFTER IT IS PLACED. EXPOSED SURFACES SHALL BE KEPT CONTINUOUSLY MOIST FOR THE ENTIRE PERIOD, OR UNTIL CURING COMPOUND IS APPLIED AS SPECIFIED BELOW. MOISTURE SHALL BE MAINTAINED BY SPRINKLING, FLOODING OR FOG SPRAYING OR BY COVERING WITH CONTINUOUSLY MOISTENED CANVAS, CLOTH MATS, STRAW, SAND OR OTHER APPROVED MATERIAL. WATER OR COVERING SHALL BE APPLIED IN SUCH A WAY THAT THE CONCRETE SURFACE IS NOT ERODED OR OTHERWISE DAMAGED.

THE GROUTED ROCK MAY BE COATED WITH AN APPROVED CURING COMPOUND IN LIEU OF CONTINUED APPLICATION OF MOISTURE. THE COMPOUND SHALL BE SPRAYED ON THE MOIST CONCRETE SURFACES AS SOON AS FREE WATER HAS DISAPPEARED, BUT SHALL NOT BE APPLIED TO ANY SURFACE UNTIL FINISHING OF THAT SURFACE IS COMPLETED. THE COMPOUND SHALL BE APPLIED AT A UNIFORM RATE OF NOT LESS THAN ONE GALLON PER 150 SQUARE FEET OF SURFACE AND SHALL FORM A CONTINUOUS ADHERENT MEMBRANE OVER THE ENTIRE SURFACE. CURING COMPOUND SHALL NOT BE APPLIED TO SURFACES REQUIRING BOND TO SUBSEQUENTLY PLACED CONCRETE. IF THE MEMBRANE IS DAMAGED DURING THE CURING PERIOD, THE DAMAGED AREA SHALL BE RESPRAYED AT THE RATE OF APPLICATION SPECIFIED ABOVE.

GROUT MIX SHALL NOT BE PLACED WHEN THE DAILY MINIMUM TEMPERATURE IS LESS THAN 40° F UNLESS FACILITIES ARE PROVIDED TO INSURE THAT THE TEMPERATURE OF THE MATERIALS IS MAINTAINED AT NOT LESS THAN 50° F NOR MORE THAN 90° F DURING PLACEMENT AND THE CURING PERIOD. GROUT MIX SHALL NOT BE PLACED ON FROZEN SURFACES. WHEN FREEZING CONDITIONS PREVAIL, ROCK TO BE GROUTED MUST BE COVERED AND HEATED TO A RANGE OF 50° F TO 90° F FOR AT LEAST 24 HOURS PRIOR TO PLACING TREATMENT MATERIALS.

### 8. INSPECTING AND TESTING FRESH GROUT

THE ENGINEER WILL INSPECT AND TEST GROUT DURING THE COURSE OF THE WORK. SAMPLING OF FRESH GROUT WILL BE DONE BY THE METHODS PRESCRIBED IN ASTM DESIGNATION C 172. THE VOLUME OF EACH BATCH WILL BE DETERMINED BY THE METHODS PRESCRIBED IN ASTM DESIGNATION C 138.

THE ENGINEER SHALL HAVE FREE ENTRY TO ALL PARTS OF THE CONTRACTOR'S PLANT AND EQUIPMENT WHICH CONCERN MIXING AND PLACING THE GROUT WHILE WORK ON THE CONTRACT IS BEING PERFORMED. PROPER FACILITIES SHALL BE PROVIDED FOR THE ENGINEER TO INSPECT MATERIALS AND PROCESSES USED IN MIXING AND PLACING THE GROUT AS WELL AS FOR SECURING SAMPLES OF THE GROUT MIX. ALL TESTS AND INSPECTIONS SHALL BE SO CONDUCTED AS NOT TO INTERFERE UNNECESSARILY WITH THE MIXING AND PLACING OF THE GROUT.

WHEN READY-MIXED GROUT IS FURNISHED, THE CONTRACTOR SHALL FURNISH TO THE ENGINEER A STATEMENT-OF-DELIVERY TICKET FOR EACH BATCH DELIVERED TO THE JOB SITE. THE TICKET SHALL SHOW THE TOTAL WEIGHTS IN POUNDS OF CEMENT, WATER, AND FINE AND COARSE AGGREGATES, AMOUNT OF AIR-ENTRAINING AGENT, TIME OF LOADING, AND THE REVOLUTION COUNTER READING AT THE TIME OF BATCHING.

### 9. MEASUREMENT AND PAYMENT

FOR ITEMS OF WORK FOR WHICH SPECIFIC UNIT PRICES ARE ESTABLISHED IN THE CONTRACT, THE QUANTITY OF CONCRETE GROUT PLACED WITHIN THE SPECIFIED LIMITS WILL BE COMPUTED TO THE NEAREST 0.1 CUBIC YARD BY VOLUME. THE VOLUME OF GROUT WILL BE DETERMINED FROM THE SUMMATION OF ALL STATEMENT-OF-DELIVERY TICKETS FOR CONCRETE GROUT DELIVERED TO THE SITE AND ACCEPTABLY PLACED IN THE WORK.

PAYMENT FOR THE CONCRETE GROUT WILL BE MADE AT THE CONTRACT UNIT PRICE FOR EACH ITEM. SUCH PAYMENT WILL BE CONSIDERED FULL COMPENSATION FOR ALL LABOR, MATERIALS, EQUIPMENT, AND ALL OTHER ITEMS NECESSARY AND INCIDENTAL TO THE COMPLETION OF THE WORK.

COMPENSATION FOR ANY ITEM OF WORK DESCRIBED IN THE CONTRACT BUT NOT LISTED IN THE BID SCHEDULE WILL BE INCLUDED IN THE PAYMENT FOR THE ITEM OF WORK TO WHICH IT IS MADE SUBSIDIARY. SUCH ITEMS AND THE ITEMS TO WHICH THEY ARE MADE SUBSIDIARY ARE IDENTIFIED IN SECTION 10 OF THIS SPECIFICATION.

### 10. ITEMS OF WORK AND CONSTRUCTION DETAILS

ITEMS OF WORK TO BE PERFORMED IN CONFORMANCE WITH THIS SPECIFICATION AND THE CONSTRUCTION DETAILS THEREFOR ARE:

(1) THIS ITEM SHALL CONSIST OF FURNISHING AND PLACING CONCRETE GROUT AS SHOWN ON THE DRAWINGS.

(2) THE GROUTING MIXTURE SHALL BE AS FOLLOWS:

- (A) CEMENT: TYPE 1A, TYPE I OR TYPE II WITH AN AIR ENTRAINING ADMIXTURE, 10 SACKS OR 940 LBS/C.Y.
- (B) FINE CONCRETE AGGREGATE: 2,100 LBS/C.Y. (SURFACE DRY WEIGHT)
- (C) WATER: 45 GAL./C.Y., OR ENOUGH TO PROVIDE A THICK CREAMY CONSISTENCY.
- (D) AIR CONTENT: 6 TO 10 PERCENT.

OTHER SIMILAR GROUT MIXES THAT INCORPORATE SMALL COARSE AGGREGATE MAY BE USED IF APPROVED IN ADVANCE BY THE ENGINEER.

(3) FLY ASH CONFORMING TO ASTM C 618 CLASS F OR CLASS C, IN AMOUNTS NOT TO EXCEED 20 PERCENT BASED ON ABSOLUTE VOLUME, MAY BE SUBSTITUTED FOR AN EQUIVALENT AMOUNT OF PORTLAND CEMENT IN THE GROUT MIXTURE.

(4) THE GROUT SHALL BE CONSOLIDATED INTO THE VOIDS WITH THE USE OF A CONCRETE VIBRATOR.

(5) GROUTING OPERATION SHALL NOT BE PERFORMED EXCEPT IN THE PRESENCE OF THE ENGINEER.

(6) A SMOOTH SURFACE IS NOT TO BE CREATED BY THE GROUTING OPERATIONS.

(7) THE AVERAGE RATE OF GROUT APPLICATION SHALL BE 5.4 CUBIC FEET OF GROUT PER SQUARE YARD OF LOOSE ROCK RIPRAP.

## REMOVAL OF WATER

### 1. SCOPE

THE WORK SHALL CONSIST OF REMOVAL OF SURFACE WATER AND GROUND WATER AS NEEDED TO PERFORM THE REQUIRED CONSTRUCTION IN ACCORDANCE WITH THE SPECIFICATIONS. IT SHALL INCLUDE (1) BUILDING AND MAINTAINING ALL NECESSARY TEMPORARY IMPOUNDING WORKS, CHANNELS, AND DIVERSIONS, (2) FURNISHING, INSTALLING AND OPERATING ALL NECESSARY PUMPS, PIPING AND OTHER FACILITIES AND EQUIPMENT, AND (3) REMOVING ALL SUCH TEMPORARY WORKS AND EQUIPMENT AFTER THEY HAVE SERVED THEIR PURPOSES.

### 2. DIVERTING SURFACE WATER

THE CONTRACTOR SHALL BUILD, MAINTAIN AND OPERATE ALL COFFERDAMS, CHANNELS, FLUMES, SUMPS, AND OTHER TEMPORARY DIVERSION AND PROTECTIVE WORKS NEEDED TO DIVERT STREAMFLOW AND OTHER SURFACE WATER THROUGH OR AROUND THE CONSTRUCTION SITE AND AWAY FROM THE CONSTRUCTION WORK WHILE CONSTRUCTION IS IN PROGRESS. UNLESS OTHERWISE SPECIFIED, DIVERSION MUST DISCHARGE INTO THE SAME NATURAL DRAINAGEWAY IN WHICH ITS HEADWORKS ARE LOCATED.

UNLESS OTHERWISE SPECIFIED, THE CONTRACTOR SHALL FURNISH TO THE CONTRACTING OFFICER, IN WRITING, HIS PLAN FOR DIVERTING SURFACE WATER BEFORE BEGINNING THE CONSTRUCTION WORK FOR WHICH THE DIVERSION IS REQUIRED. ACCEPTANCE OF THIS PLAN WILL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR COMPLETING THE WORK AS SPECIFIED.

### 3. DEWATERING THE CONSTRUCTION SITE

FOUNDATIONS, CUTOFF TRENCHES AND OTHER PARTS OF THE CONSTRUCTION SITE SHALL BE DEWATERED AND KEPT FREE OF STANDING WATER OR EXCESSIVELY MUDDY CONDITIONS AS NEEDED FOR PROPER EXECUTION OF THE CONSTRUCTION WORK. THE CONTRACTOR SHALL FURNISH, INSTALL, OPERATE AND MAINTAIN ALL DRAINS, SUMPS, PUMPS, CASINGS, WELLPOINTS, AND OTHER EQUIPMENT NEEDED TO PERFORM THE DEWATERING AS SPECIFIED. DEWATERING METHODS THAT CAUSE A LOSS OF FINES FROM FOUNDATION AREAS WILL NOT BE PERMITTED.

UNLESS OTHERWISE SPECIFIED, THE CONTRACTOR SHALL FURNISH TO THE CONTRACTING OFFICER, IN WRITING, HIS PLAN FOR DEWATERING BEFORE BEGINNING THE CONSTRUCTION WORK FOR WHICH THE DEWATERING IS REQUIRED. ACCEPTANCE OF THIS PLAN WILL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR COMPLETING THE WORK AS SPECIFIED.

### 4. EROSION AND POLLUTION CONTROL

REMOVAL OF WATER FROM THE CONSTRUCTION SITE SHALL BE ACCOMPLISHED IN SUCH A MANNER THAT EROSION AND THE TRANSMISSION OF SEDIMENT AND OTHER POLLUTANTS ARE MINIMIZED.

### 5. REMOVAL OF TEMPORARY WORKS

AFTER THE TEMPORARY WORKS HAVE SERVED THEIR PURPOSES, THE CONTRACTOR SHALL REMOVE THEM OR LEVEL AND GRADE THEM TO THE EXTENT REQUIRED TO PRESENT A SIGHTLY APPEARANCE AND TO PREVENT ANY OBSTRUCTION OF THE FLOW OF WATER OR ANY OTHER INTERFERENCE WITH THE OPERATION OF OR ACCESS TO THE PERMANENT WORKS.

EXCEPT AS OTHERWISE SPECIFIED, PIPES AND CASINGS SHALL BE REMOVED FROM TEMPORARY WELLS AND THE WELLS SHALL BE FILLED TO GROUND LEVEL WITH GRAVEL OR OTHER MATERIAL APPROVED BY THE CONTRACTING OFFICER.

### 6. MEASUREMENT AND PAYMENT

PAYMENT FOR THIS ITEM WILL BE MADE AT THE CONTRACT LUMP SUM PRICE AND WILL CONSTITUTE FULL COMPENSATION FOR COMPLETION OF THE WORK.



**SUNDQUIST ENGINEERING, P.C.**  
CONSULTING ENGINEERS

HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING

120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442

PHONE: (712)263-8118 FAX: (712)263-2181

PROJECT NO.:	0547	DATE:	7/97	REV:	
CLIENT:	CRAWFORD COUNTY, IOWA				
DRAWN BY:	TKK	REVIEWED BY:		APPROVED BY:	PJA
DESCRIPTION:	PROJECT NO. FM-24(45)-55-24 CONSTRUCTION SPECIFICATIONS				SHEET CI



## SECTION A-A


## ROCK FILLED CUTOFF TRENCH DETAILS

CONTINUOUS ACROSS BOTTOM WIDTH AND SIDE SLOPES.

- 2.5' ACROSS CHANNEL BOTTOM  
2.0' ON SIDE SLOPES  
1.5' ACROSS CHANNEL BOTTOM  
2.0' ON SIDE SLOPES



STAPLE

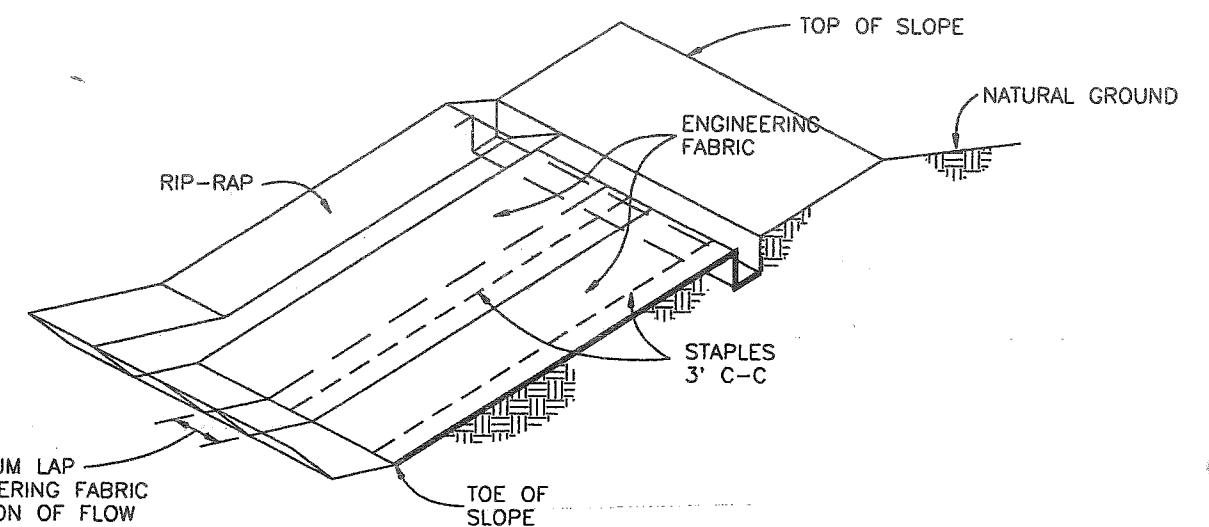

18" MINIMUM LAP  
OF ENGINEERING FABRIC  
IN DIRECTION OF FLOW

EXCAVATE 12"x12" TRENCH ALONG TOP OF RIPRAP. PLACE END OF ENGINEERING FABRIC STRIPS INTO TRENCH WITH STAPLES AS SHOWN. BACKFILL WITH THE EXCAVATED MATERIAL AND COMPACT. THE ENGINEER MAY PERMIT THE USE OF THE WHEELS OF PNEUMATIC-TIRED EQUIPMENT FOR CONSOLIDATING THE TRENCH BACKFILL MATERIAL.


## DETAILS OF PLACEMENT OF ENGINEERING FABRIC

**SE SUNDQUIST ENGINEERING, P.C.**  
CONSULTING ENGINEERS  
HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING  
120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442  
PHONE: (712)263-8118 FAX: (712)263-2181




PROJECT NO.:	0547	DATE:	7/97	REV:	
CLIENT:	CRAWFORD COUNTY, IOWA				
DRAWN BY:	TKK	REVIEWED BY:		APPROVED BY:	PJA
DESCRIPTION:	PROJECT NO. FM-24(45)-55-24				SHEET
	TYPICAL SECTIONS				

SHEET

22

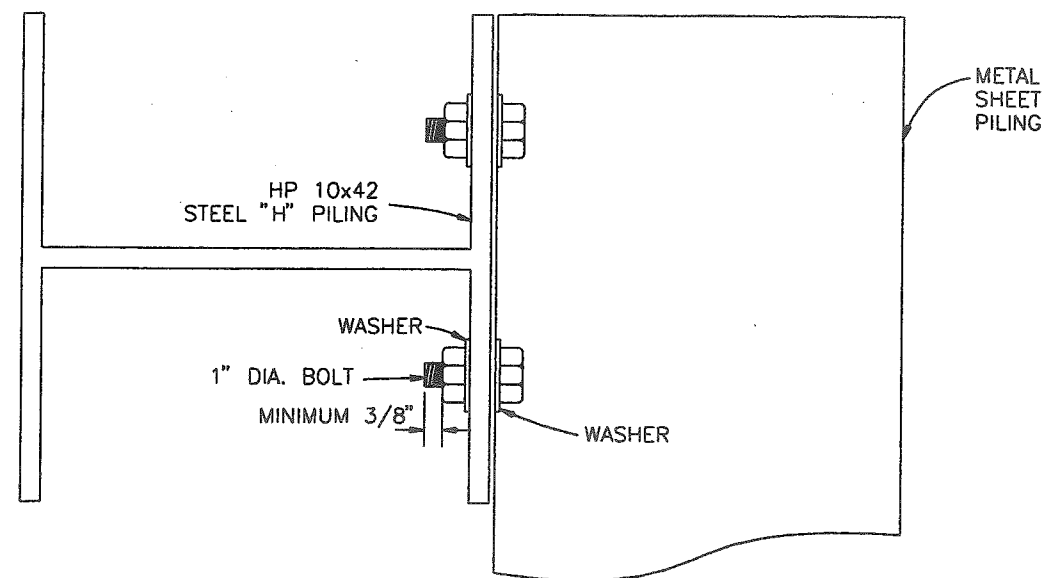

**BOLT DETAIL**

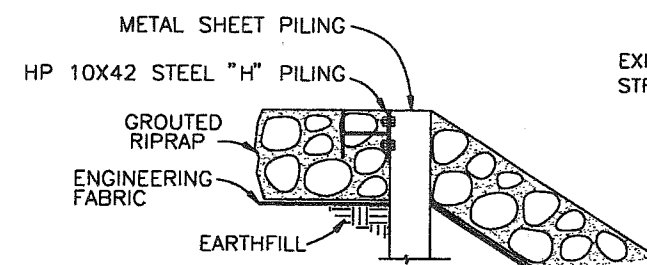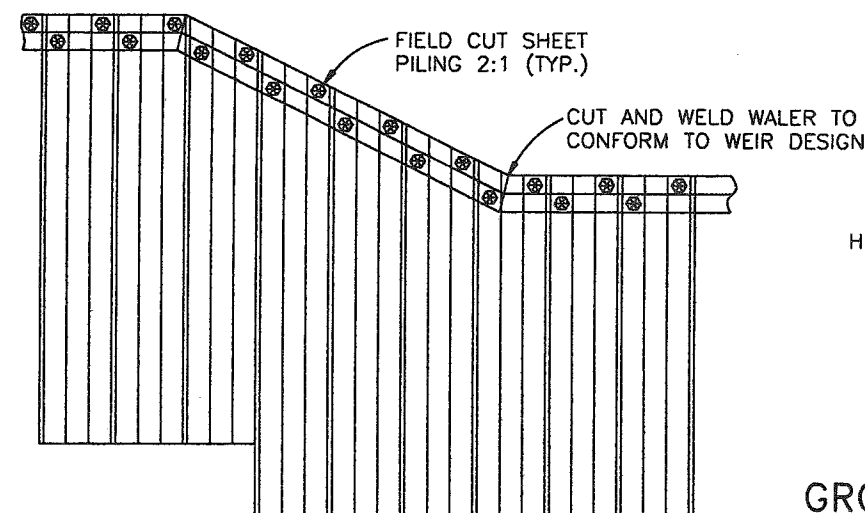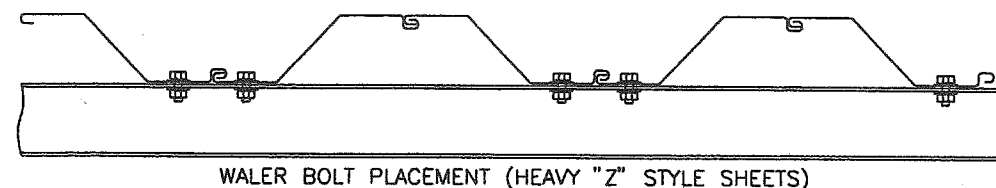


**GROUTED RIP-RAP DETAIL**

**NOTES:**

1. ALL BOLTS SHALL BE 1" DIA. W/2 WASHERS.  
BOLTS SHALL EXTEND AT MINIMUM 3/8" BEYOND NUT.
2. ALL HOLES SHALL BE FIELD CUT 1/16" DIA.  
LARGER THAN THE BOLTS.

**WALER**

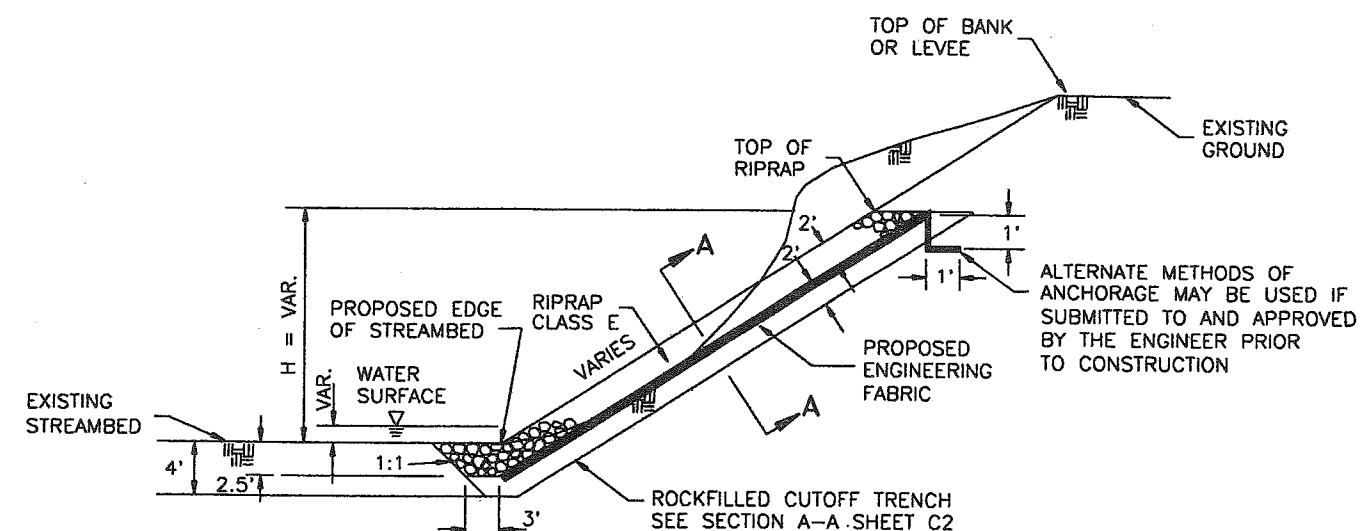

**CHANNEL CUT**

NO SCALE

**TYPICAL BANK STABILIZATION SECTION**



**SUNDQUIST ENGINEERING, P.C.**  
CONSULTING ENGINEERS  
HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING  
120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442  
PHONE: (712)263-8118 FAX: (712)263-2181

PROJECT NO.:	0547	DATE:	7/97	REV:	
CLIENT:	CRAWFORD COUNTY, IOWA				
DRAWN BY:	TKK	REVIEWED BY:		APPROVED BY:	PJA
DESCRIPTION:	PROJECT NO. FM-24(35)-55-24 TYPICAL SECTIONS				

SHEET

**C3**



# BANK REPAIR NOTE:

FILL MATERIAL PLACED AROUND EXISTING PIER PILES IS TO REMAIN UNCOMPACTED FOR A MINIMUM 3' DIAMETER AROUND THE CENTER OF THE PIER PILING.


CLEAR AND GRUB ALL TREES AND DEBRIS FROM WITHIN CHANNEL FROM STA. 50+50 TO STA. 57+00 AND ON SIDE CHANNEL FROM PORTER CREEK TO RCB CULVERT OUTLET.

**LOCATION**  
CRAWFORD COUNTY  
T-85N R-38W  
SEC. 14  
STOCKHOLM TWP.  
PORTER CREEK  
DRAINAGE AREA = 16.8 S.M.



**HYDROLOGY AND HYDRAULICS**  
DRAINAGE AREA = 16.8 SM  
CHANNEL SLOPE = 25.9 FT/MILE

STORM	CFS	FT/SEC	STAGE*	ELEV.
Q2	742	5.40	343.8	
Q5	1400	6.56	345.4	
Q10	1903	7.21	346.4	
Q25	2619	7.90	347.6	
Q50	3189	8.39	348.5	
Q100	3796	8.80	349.3	

\*AS MEASURED FROM ELEV. 340.0

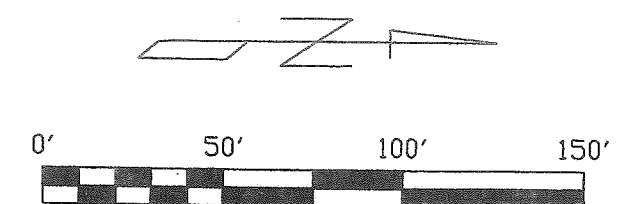


**BENCH MARK**  
#1A - R.R. SPK IN PWR POLE @  
STA. 56+68, 87' LT.  
EL. = 358.60  
  
#2A - R.R. SPK IN PWR POLE @  
STA. 56+61, 194' RT.  
EL. = 357.83

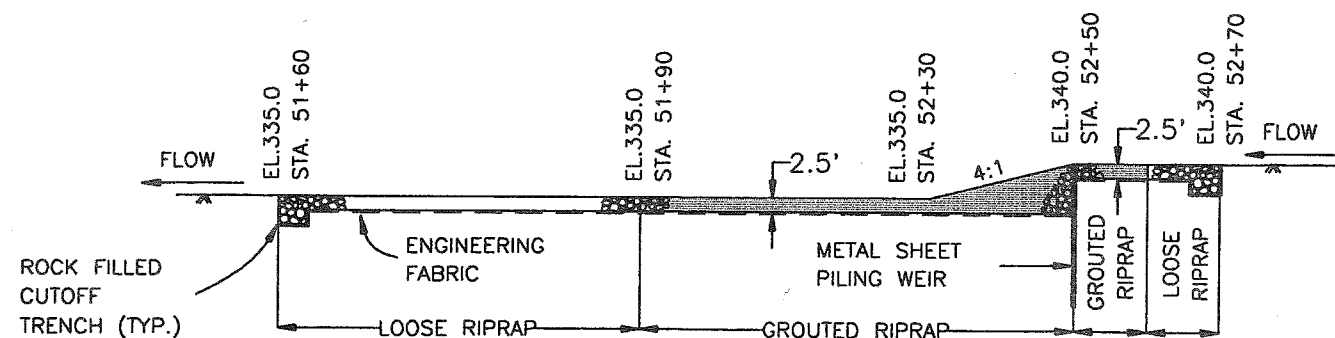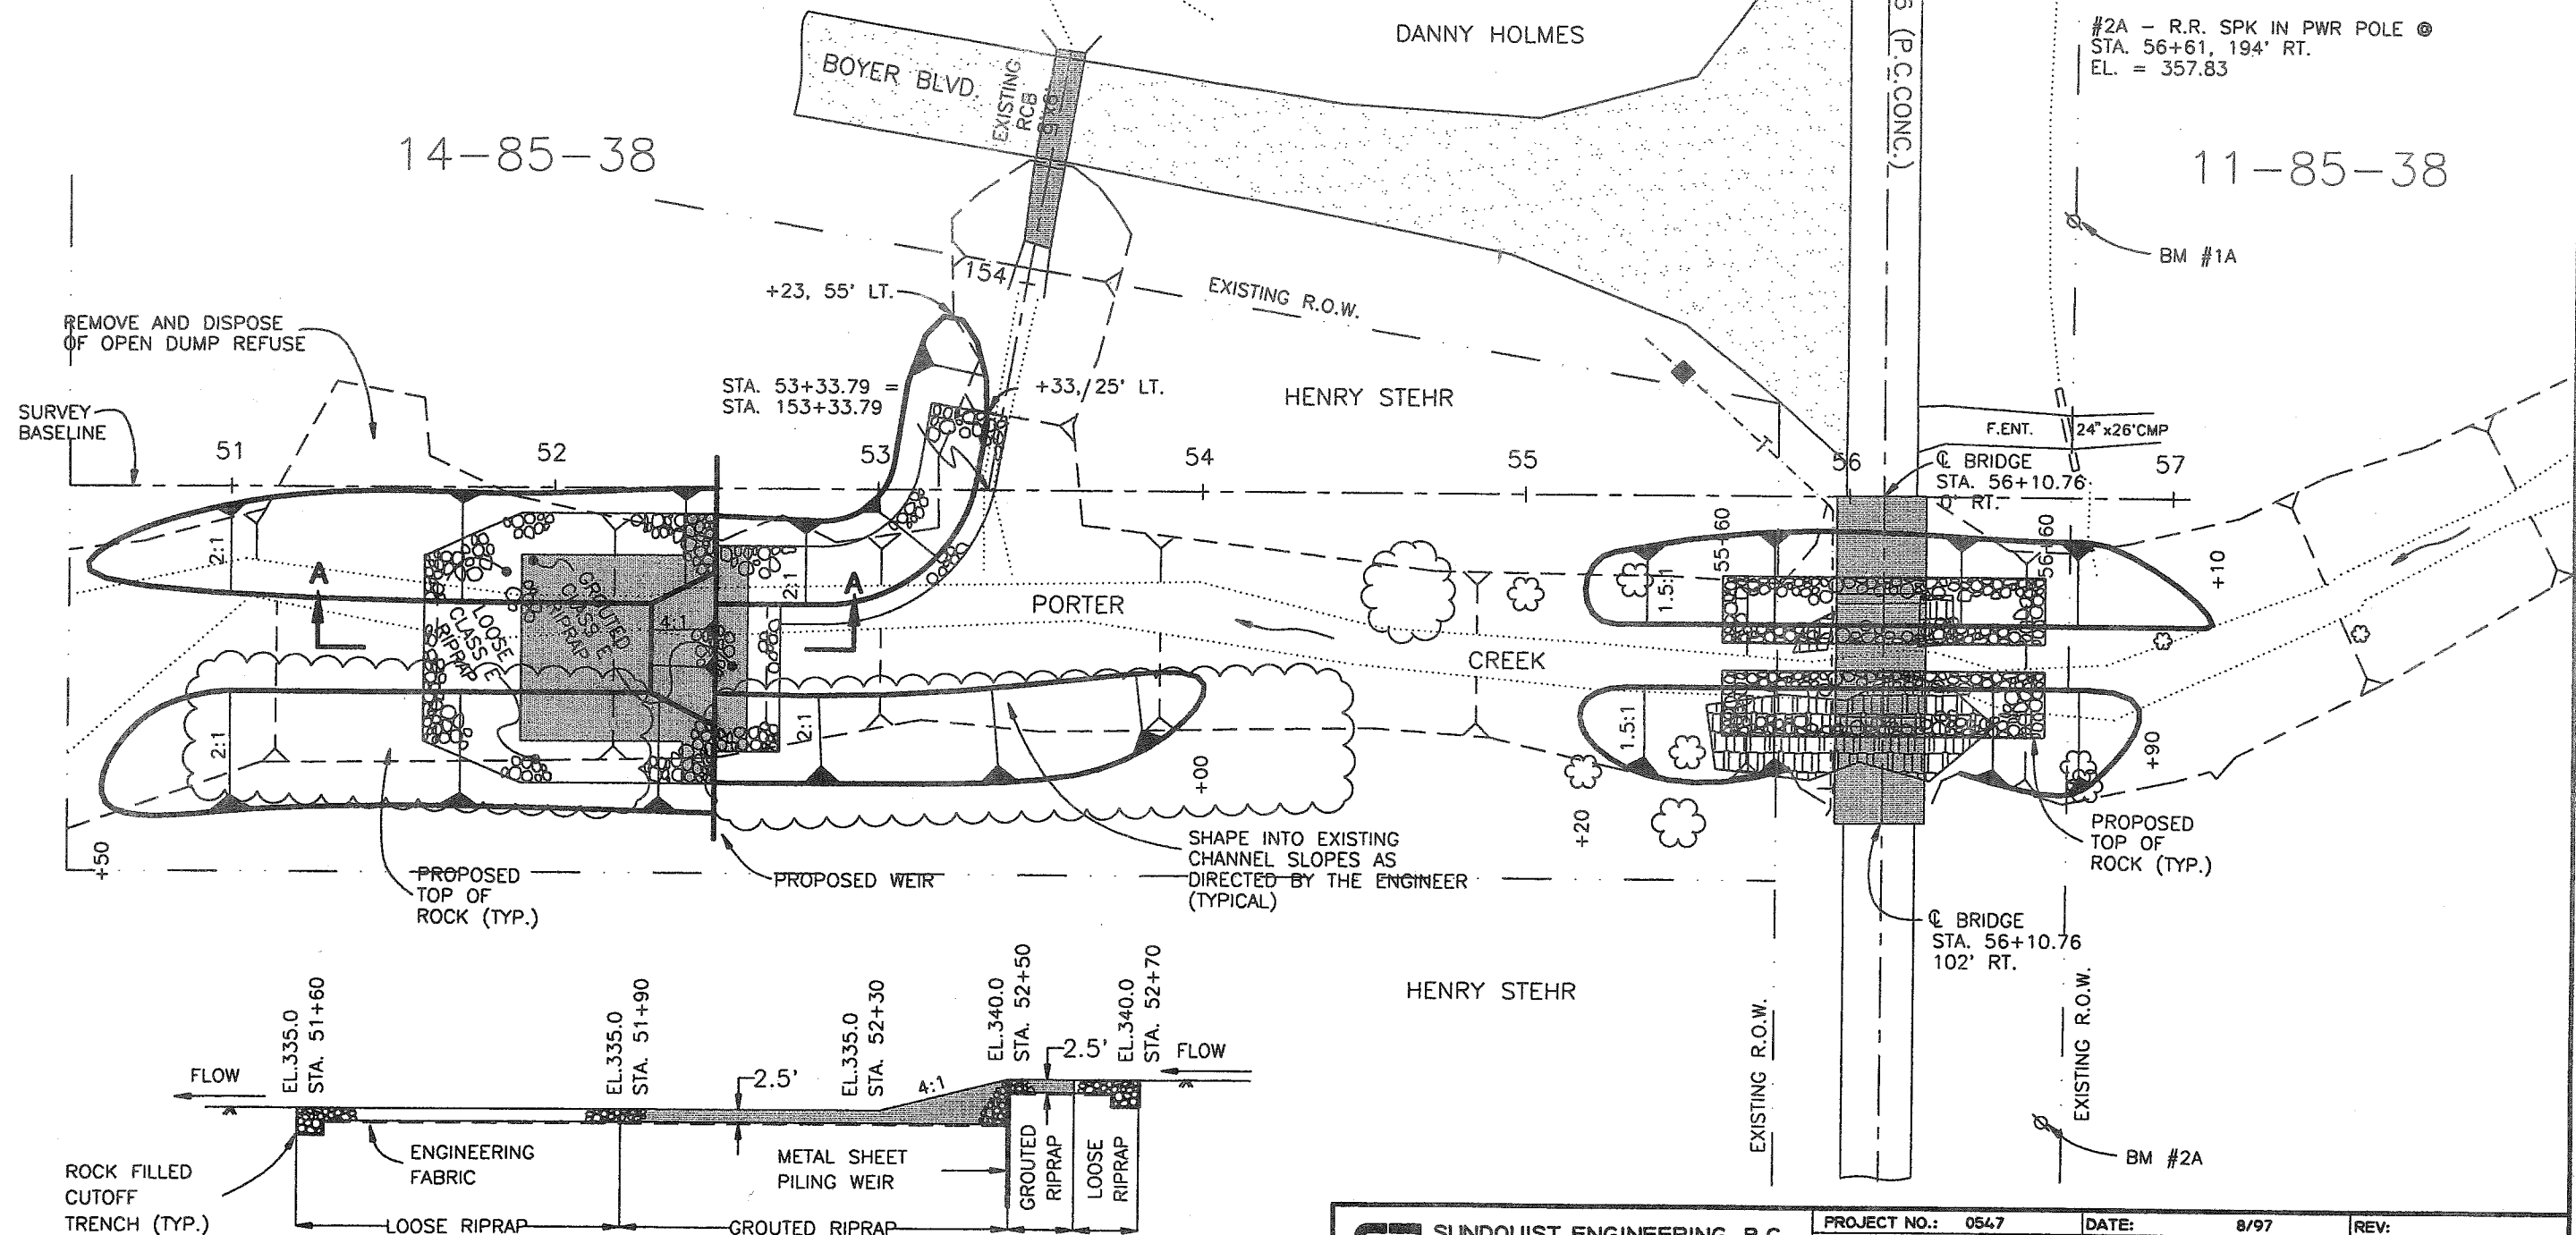


**SECTION A-A**  
NOT TO SCALE

**SUNDQUIST ENGINEERING, P.C.**  
CONSULTING ENGINEERS  
HIGHWAYS • MUNICIPAL • MAPPING • SURVEYING  
120 S. MAIN, P.O. BOX 220, DENISON, IOWA 51442  
PHONE: (712)263-8118 FAX: (712)263-2181


PROJECT NO.: 0547	DATE: 8/97	REV:
CLIENT: CRAWFORD COUNTY, IOWA		
DRAWN BY: TTK	REVIEWED BY:	APPROVED BY: PJA
DESCRIPTION: PROJECT NO. FM-24(15)-55-24		SHEET
PLAN VIEW		DI

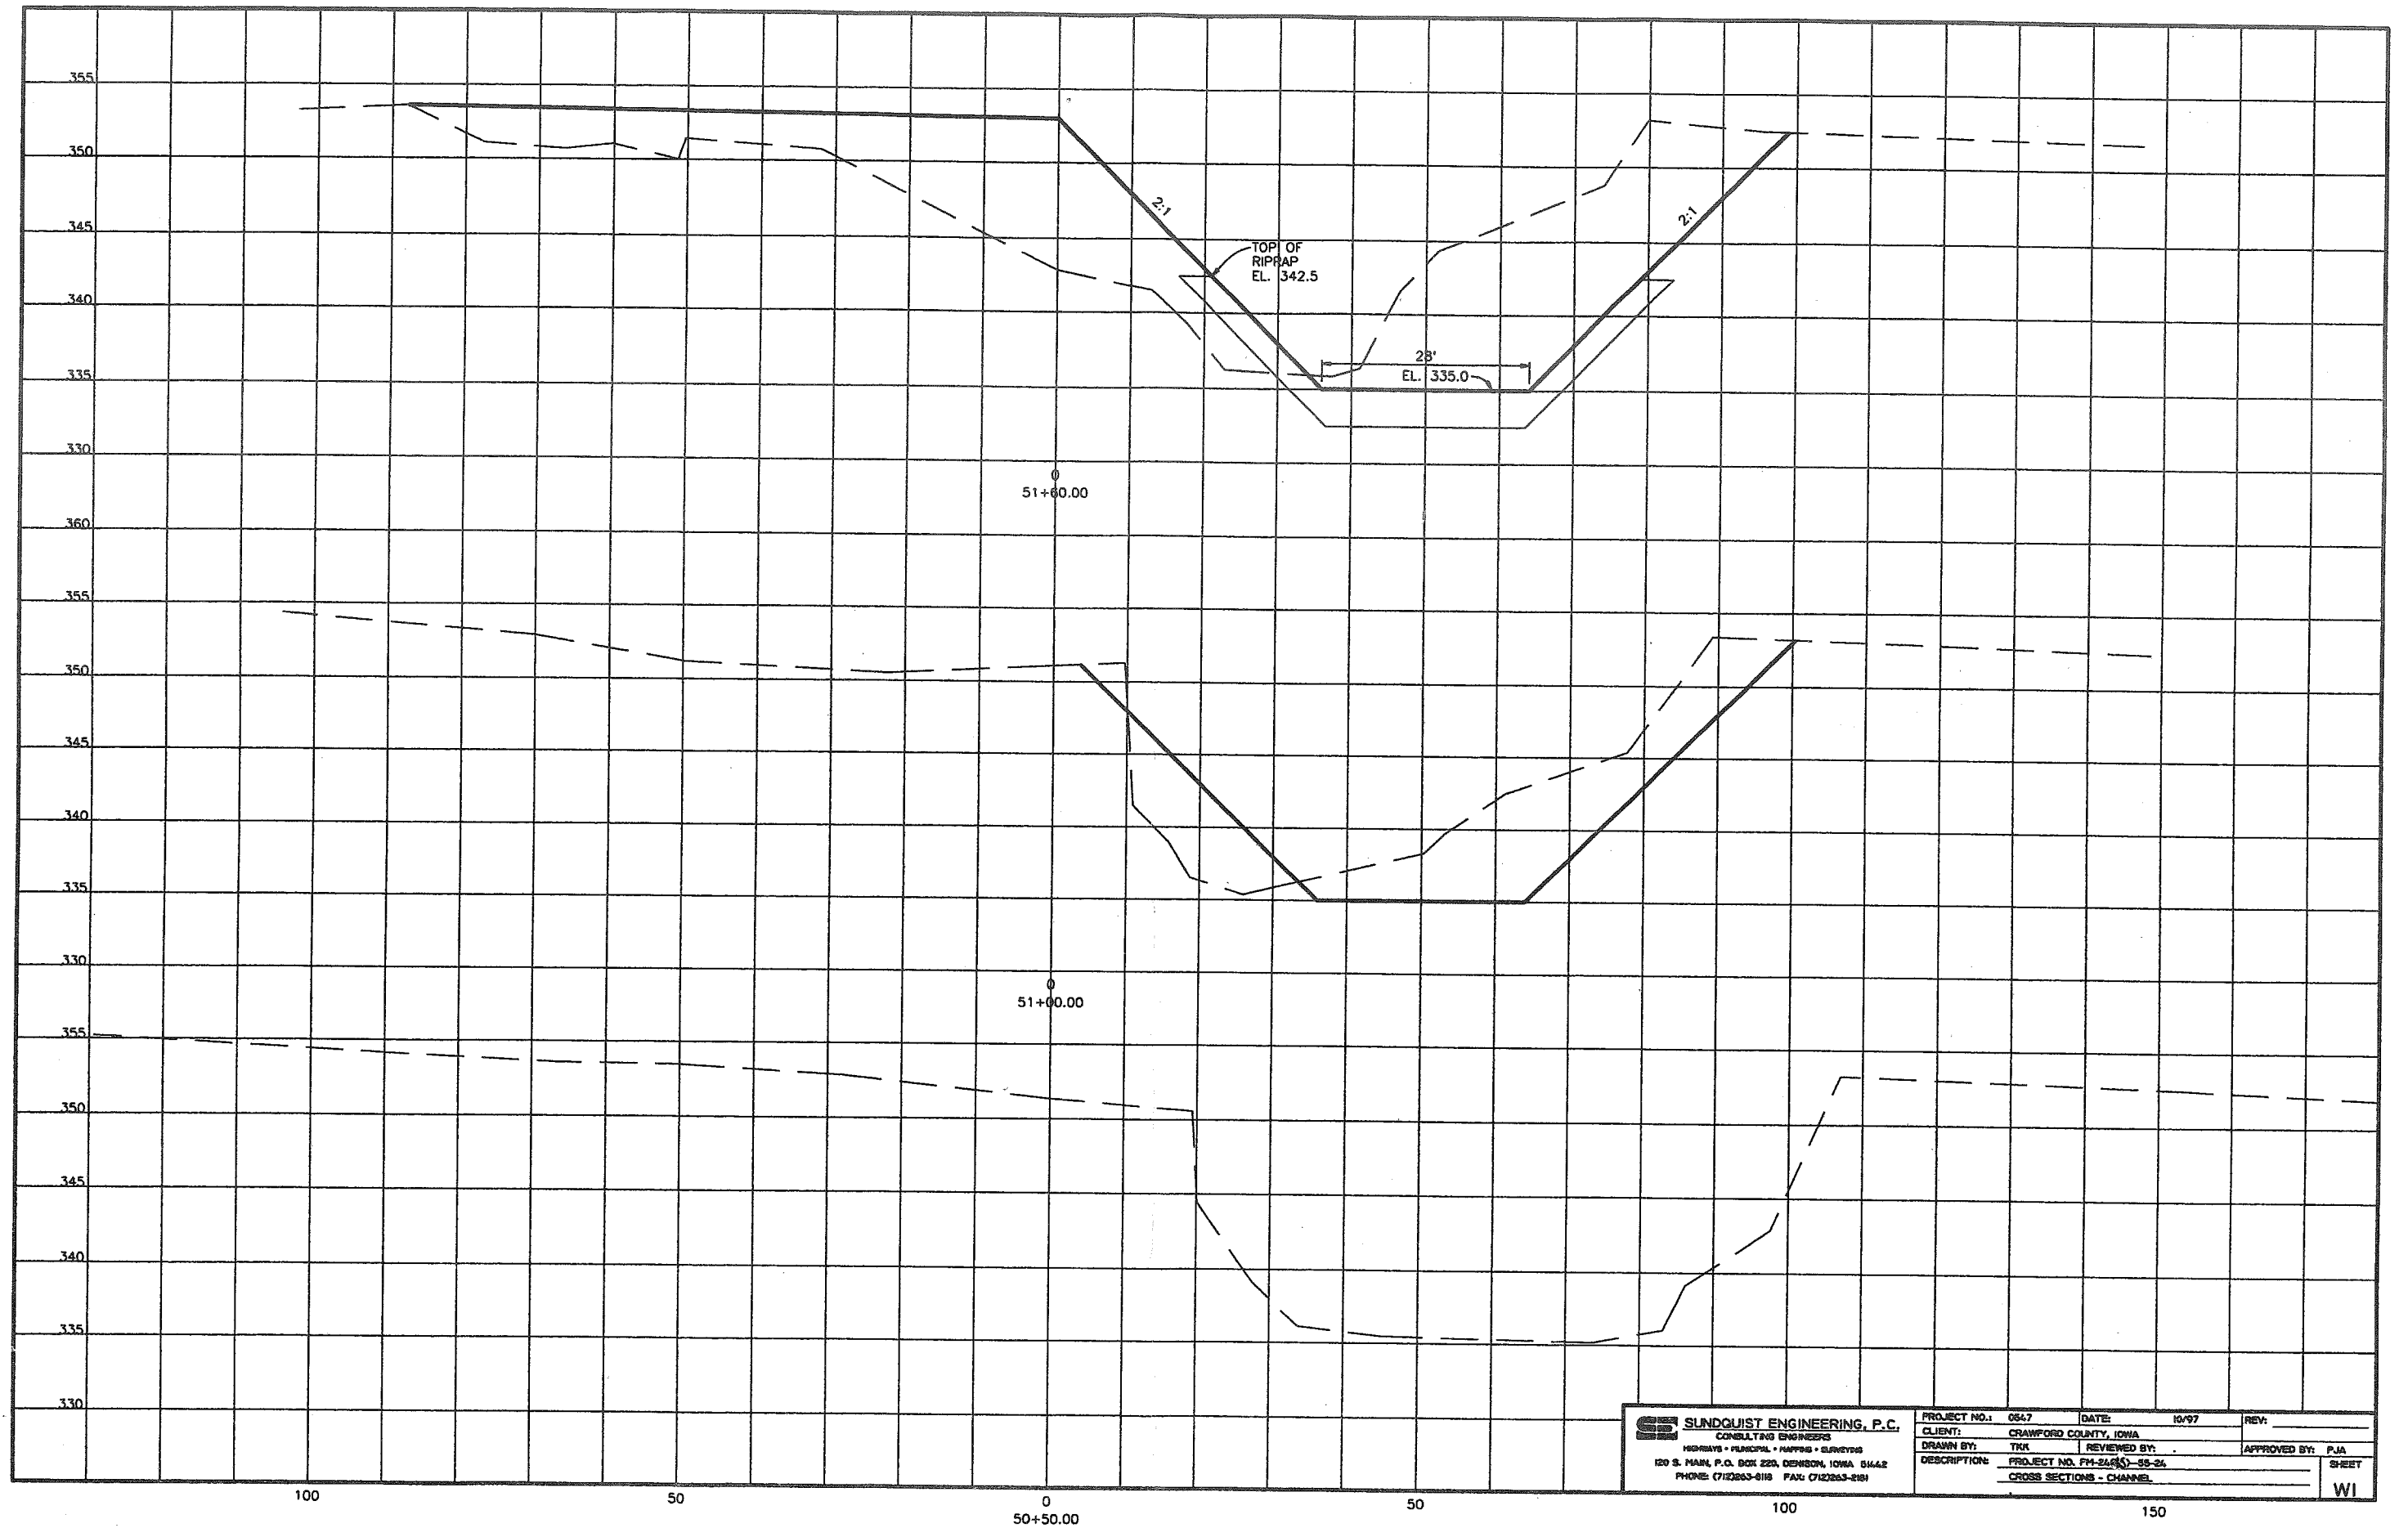



<b>SE</b> SUNDQUIST ENGINEERING, P.C. CONSULTING ENGINEERS HIGHWAYS • MUNICIPAL • MAPING • SURVEYING 120 S. MAIN, P.O. BOX 225, DENSON, IOWA 51442 PHONE (712)263-8118 FAX (712)263-2181	PROJECT NO.:	0547	DATE:	10/97	REV:	
	CLIENT:	CRAWFORD COUNTY, IOWA				
	DRAWN BY:	TKR	REVIEWED BY:		APPROVED BY:	PJA
	DESCRIPTION:	PROJECT NO. FH-24(30)-SS-24				SHEET
	CROSS SECTIONS - CHANNEL				WI	

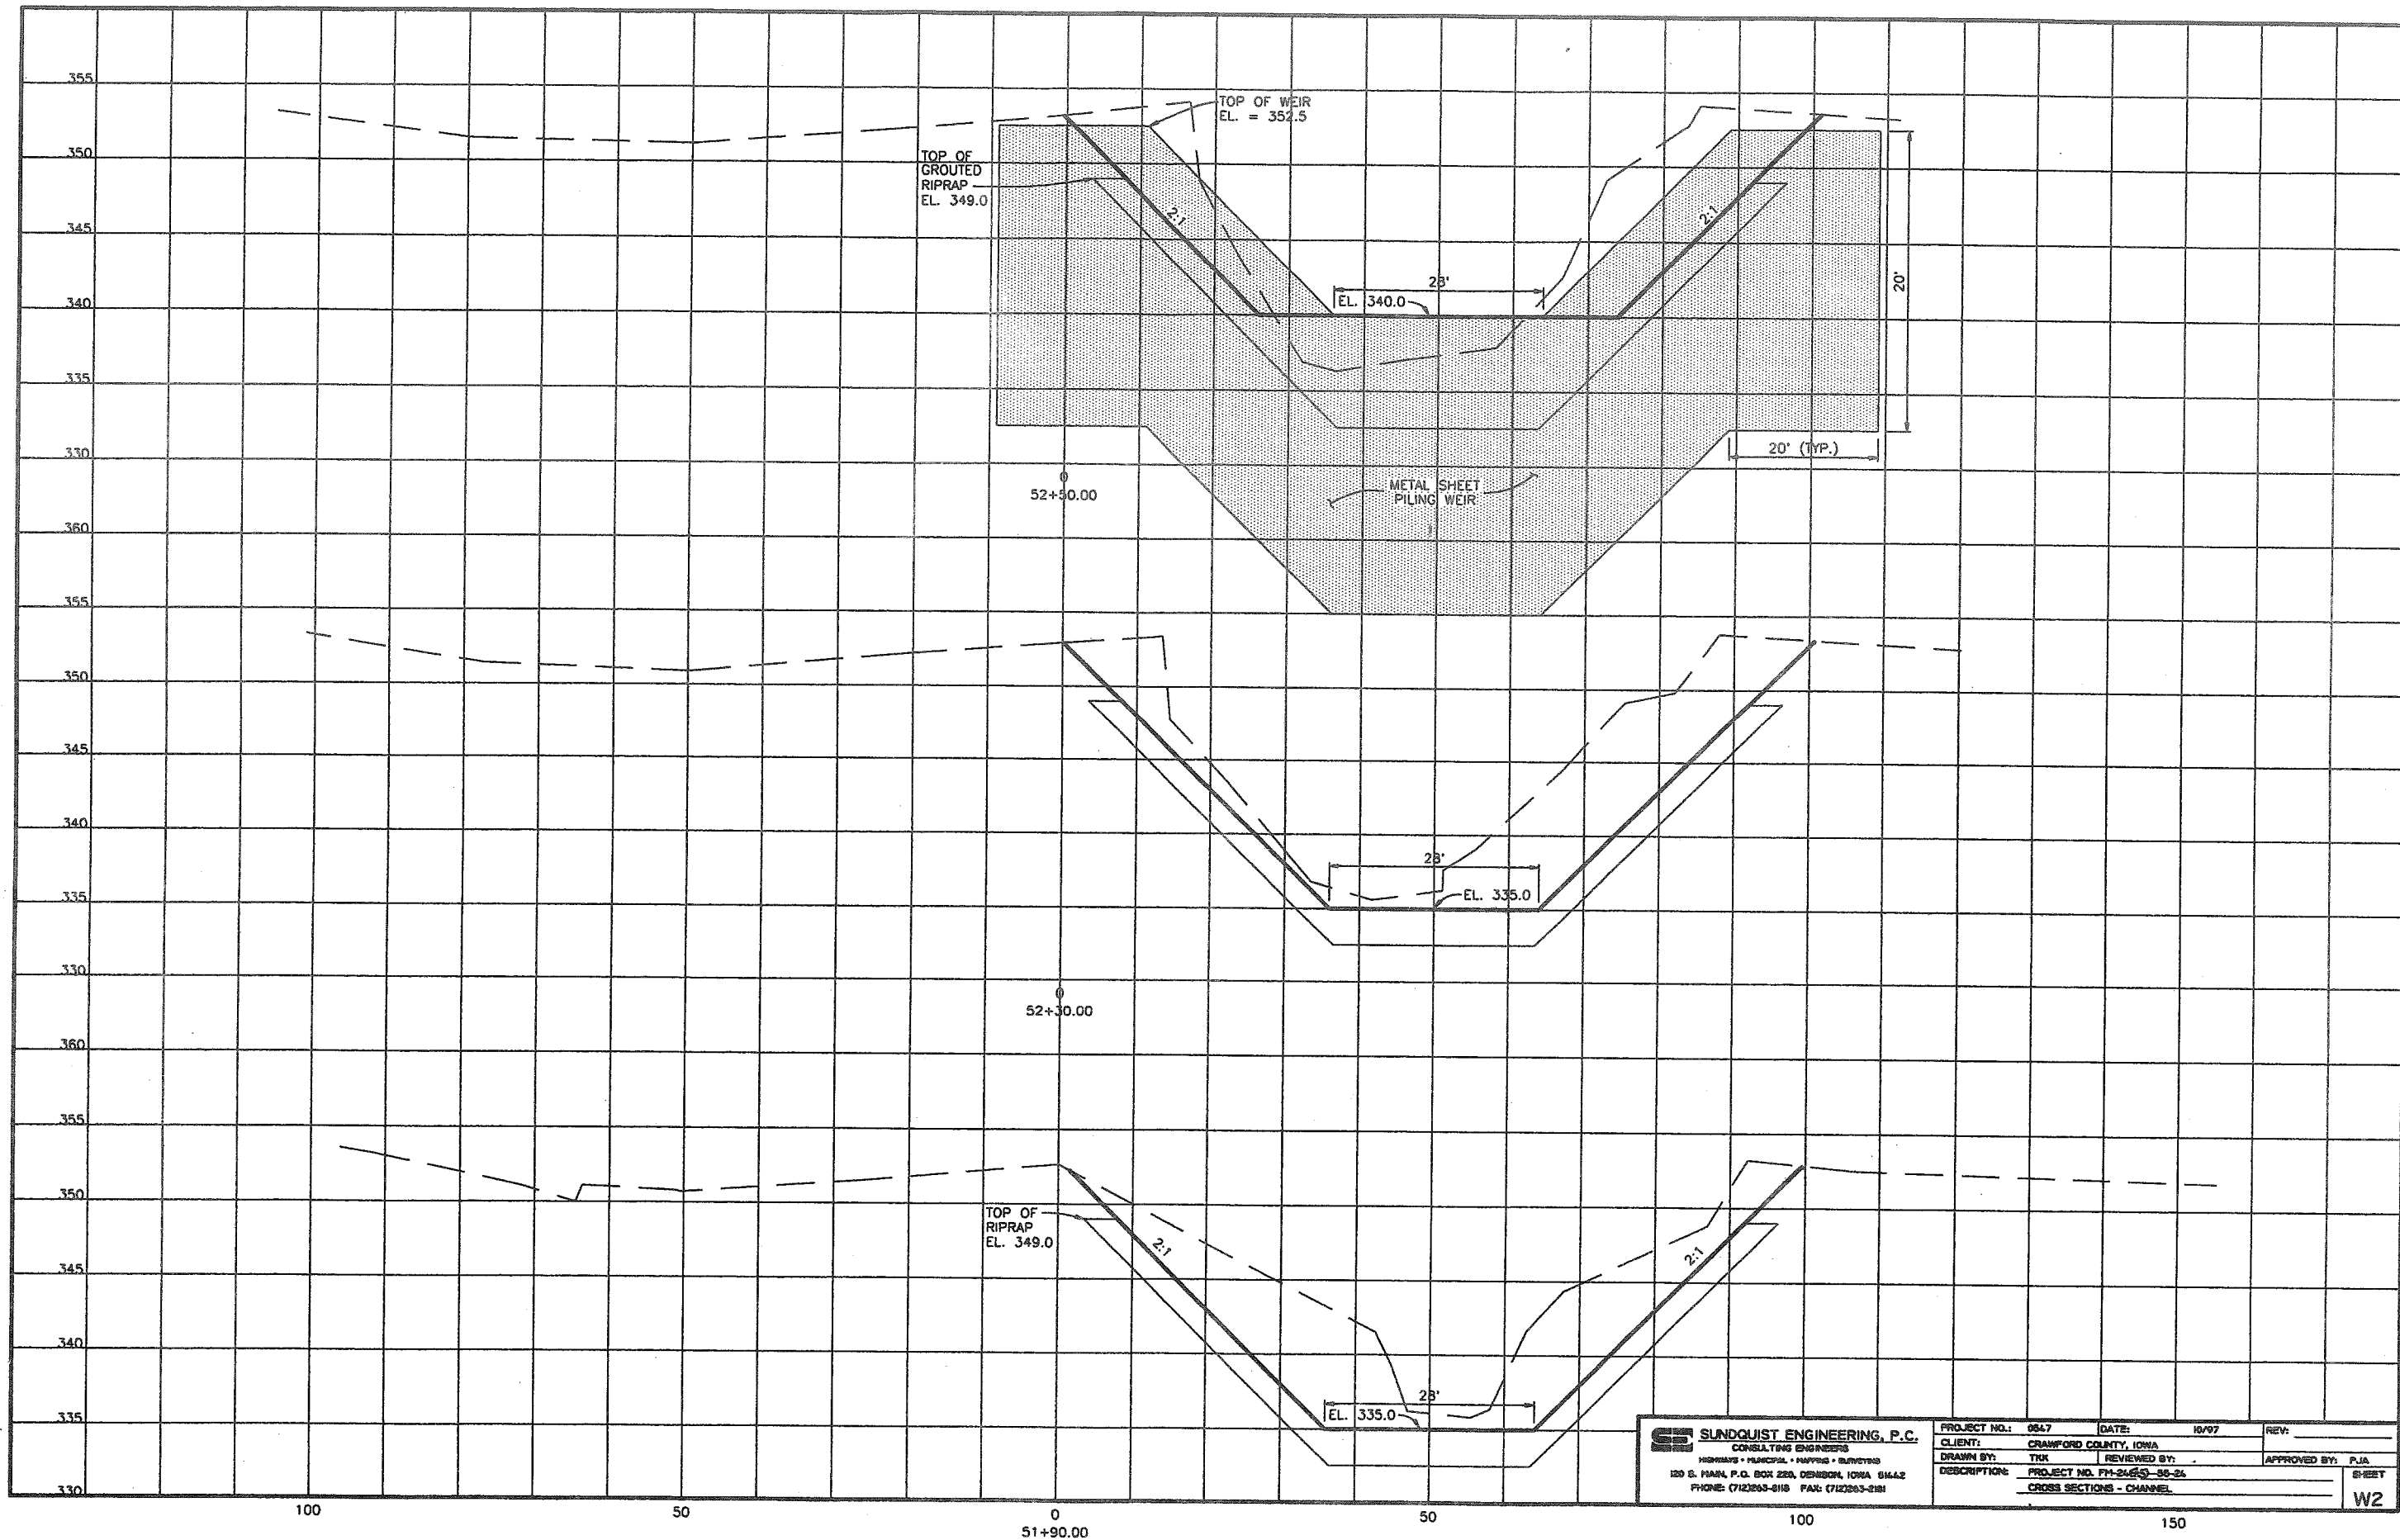




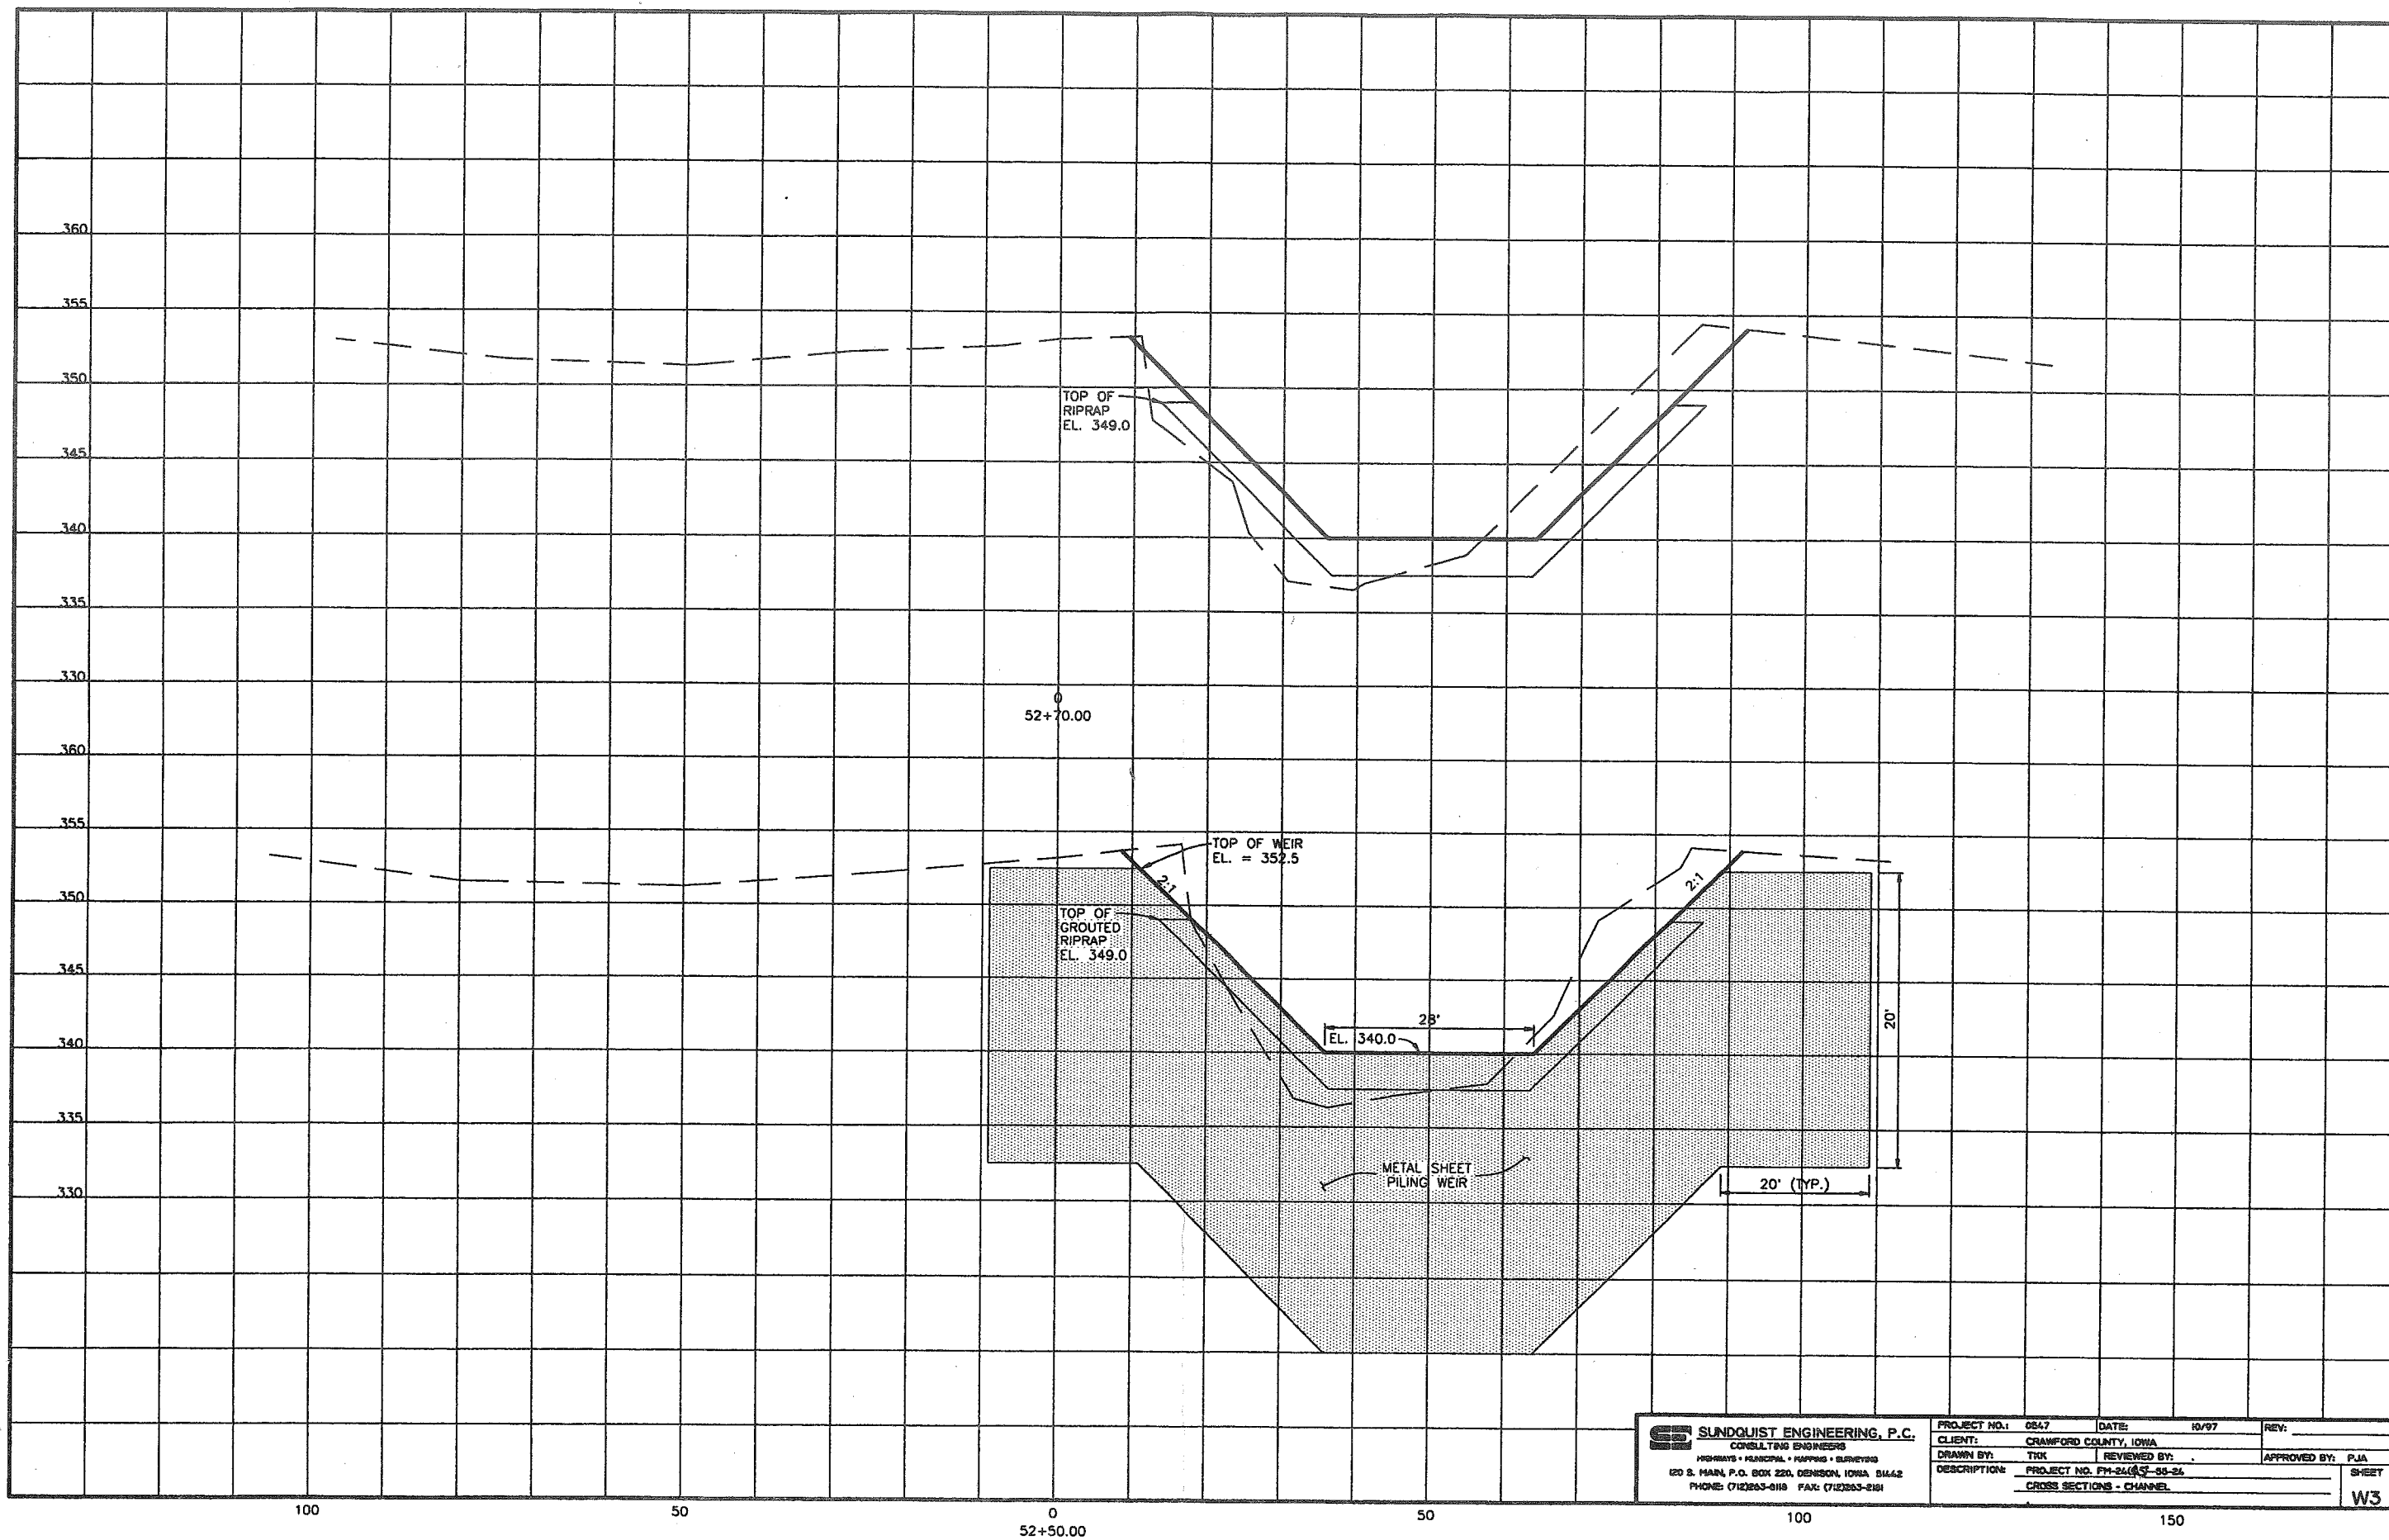

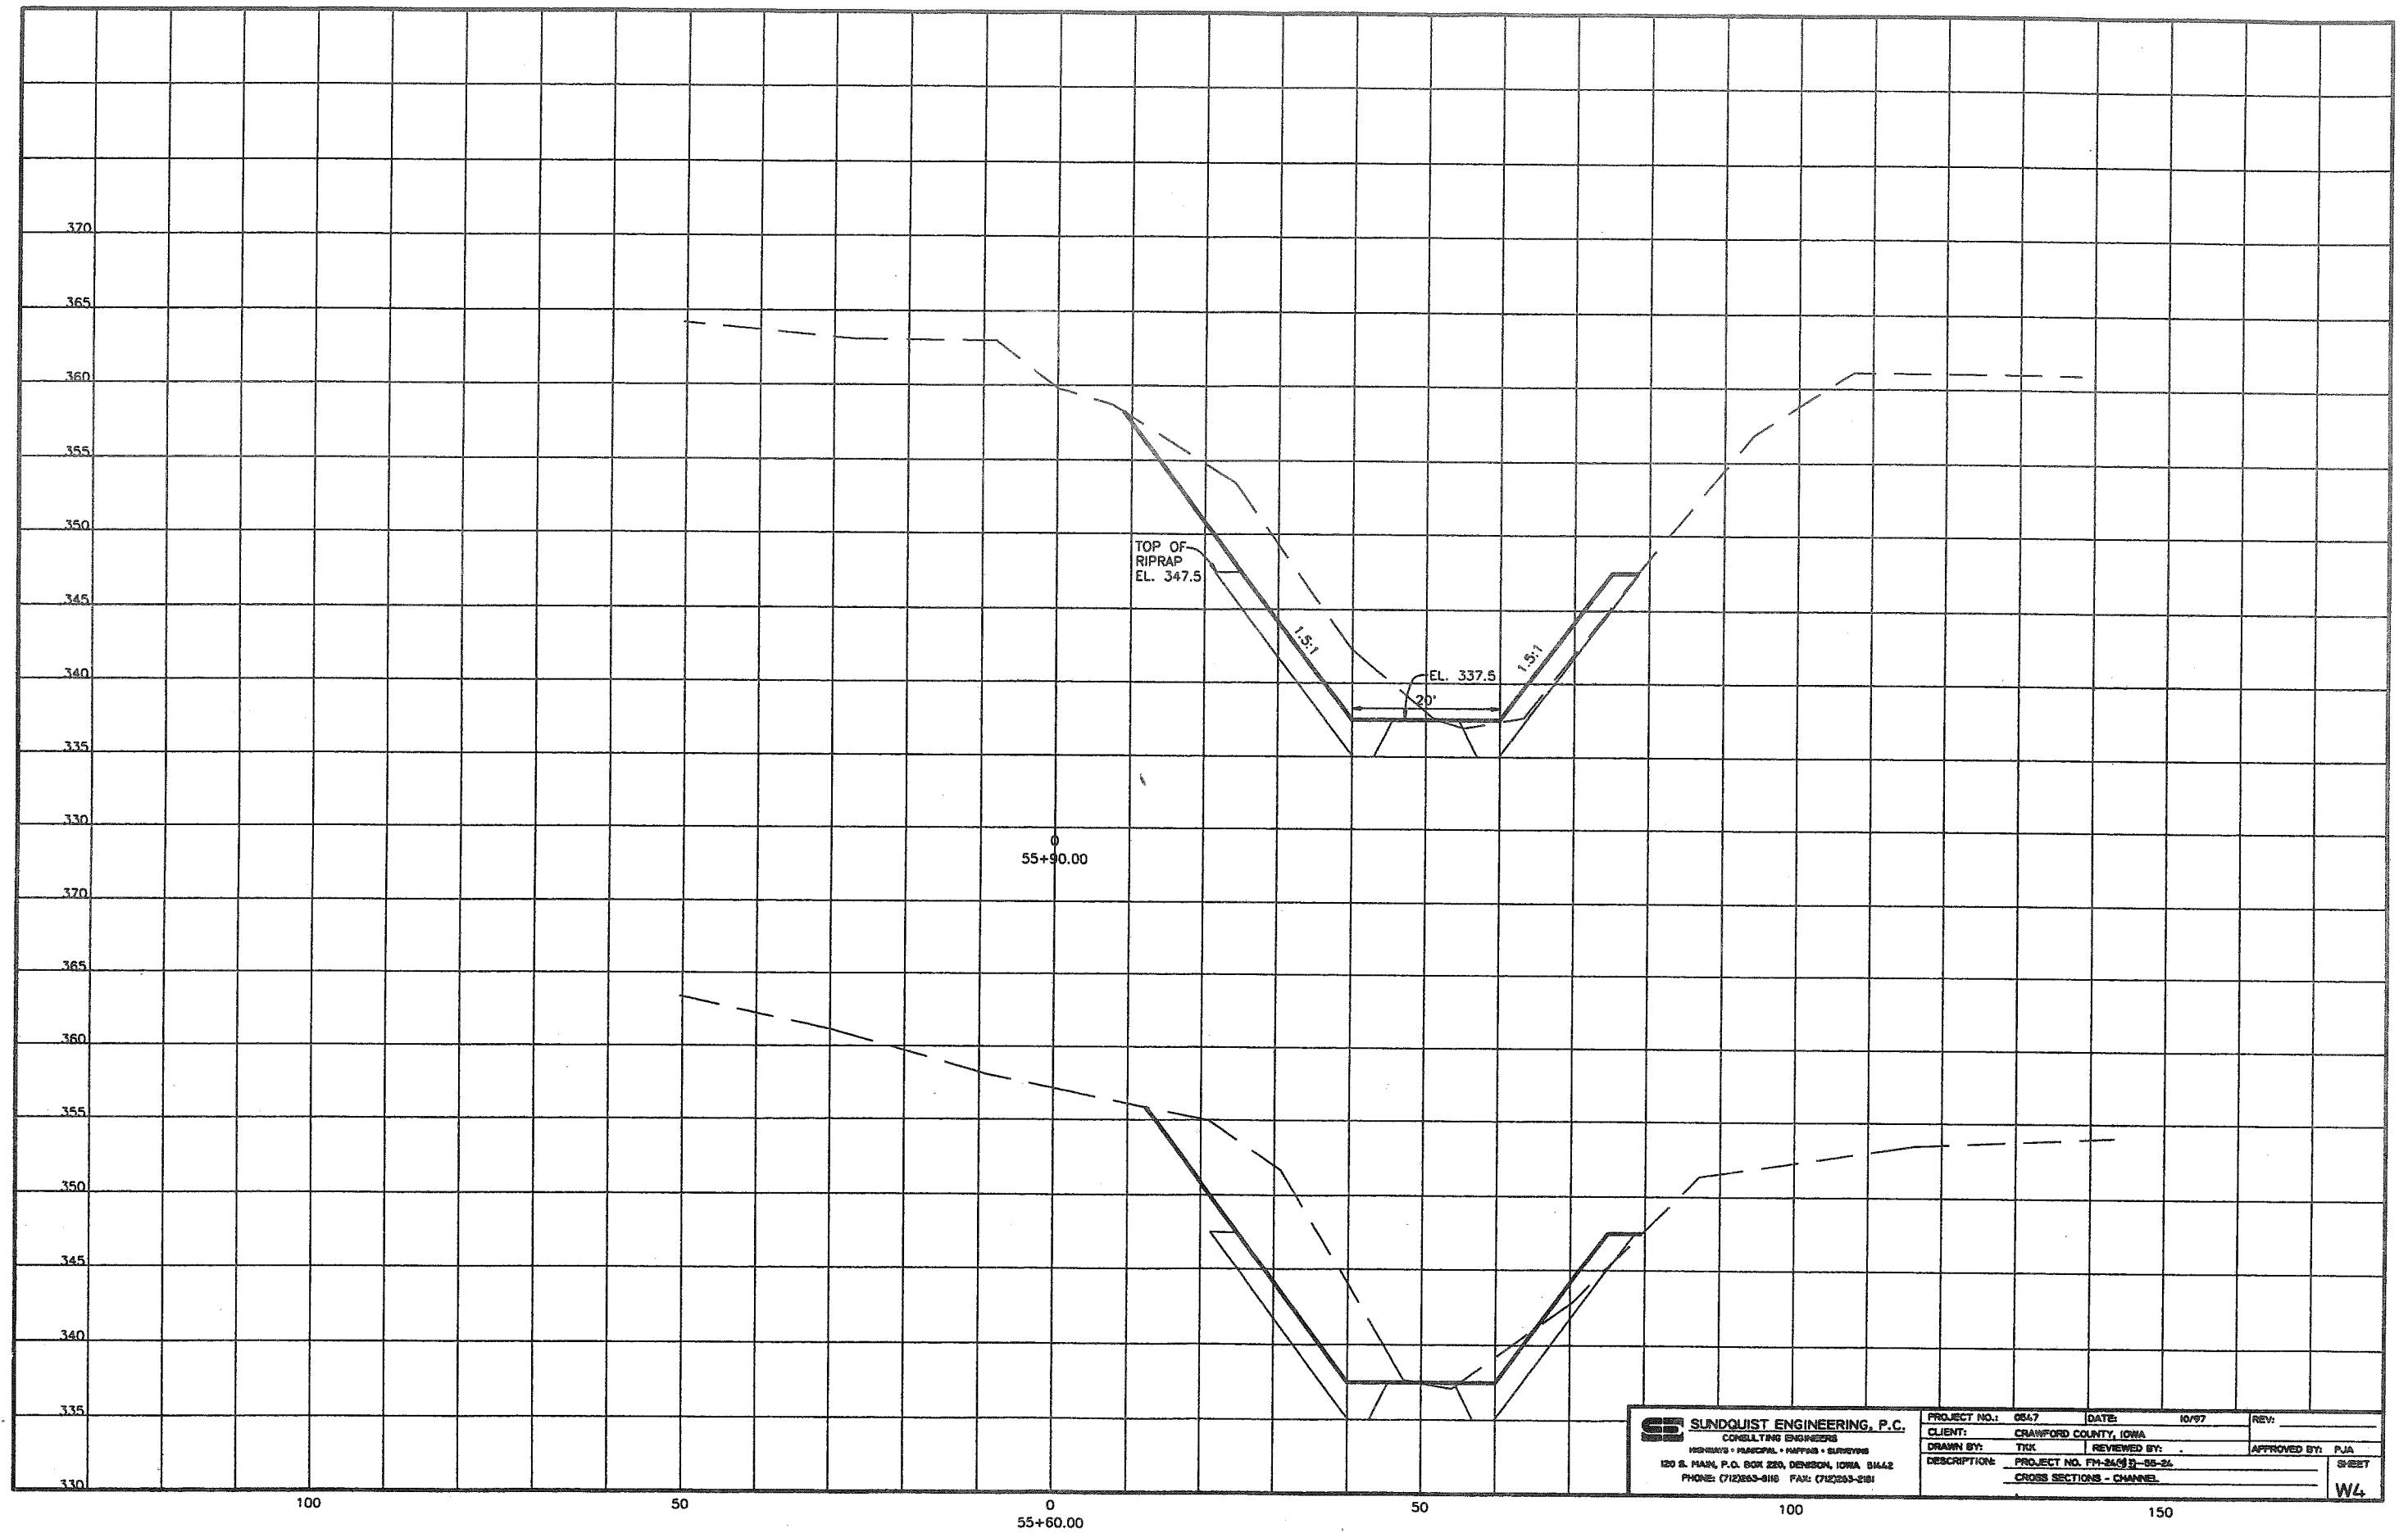

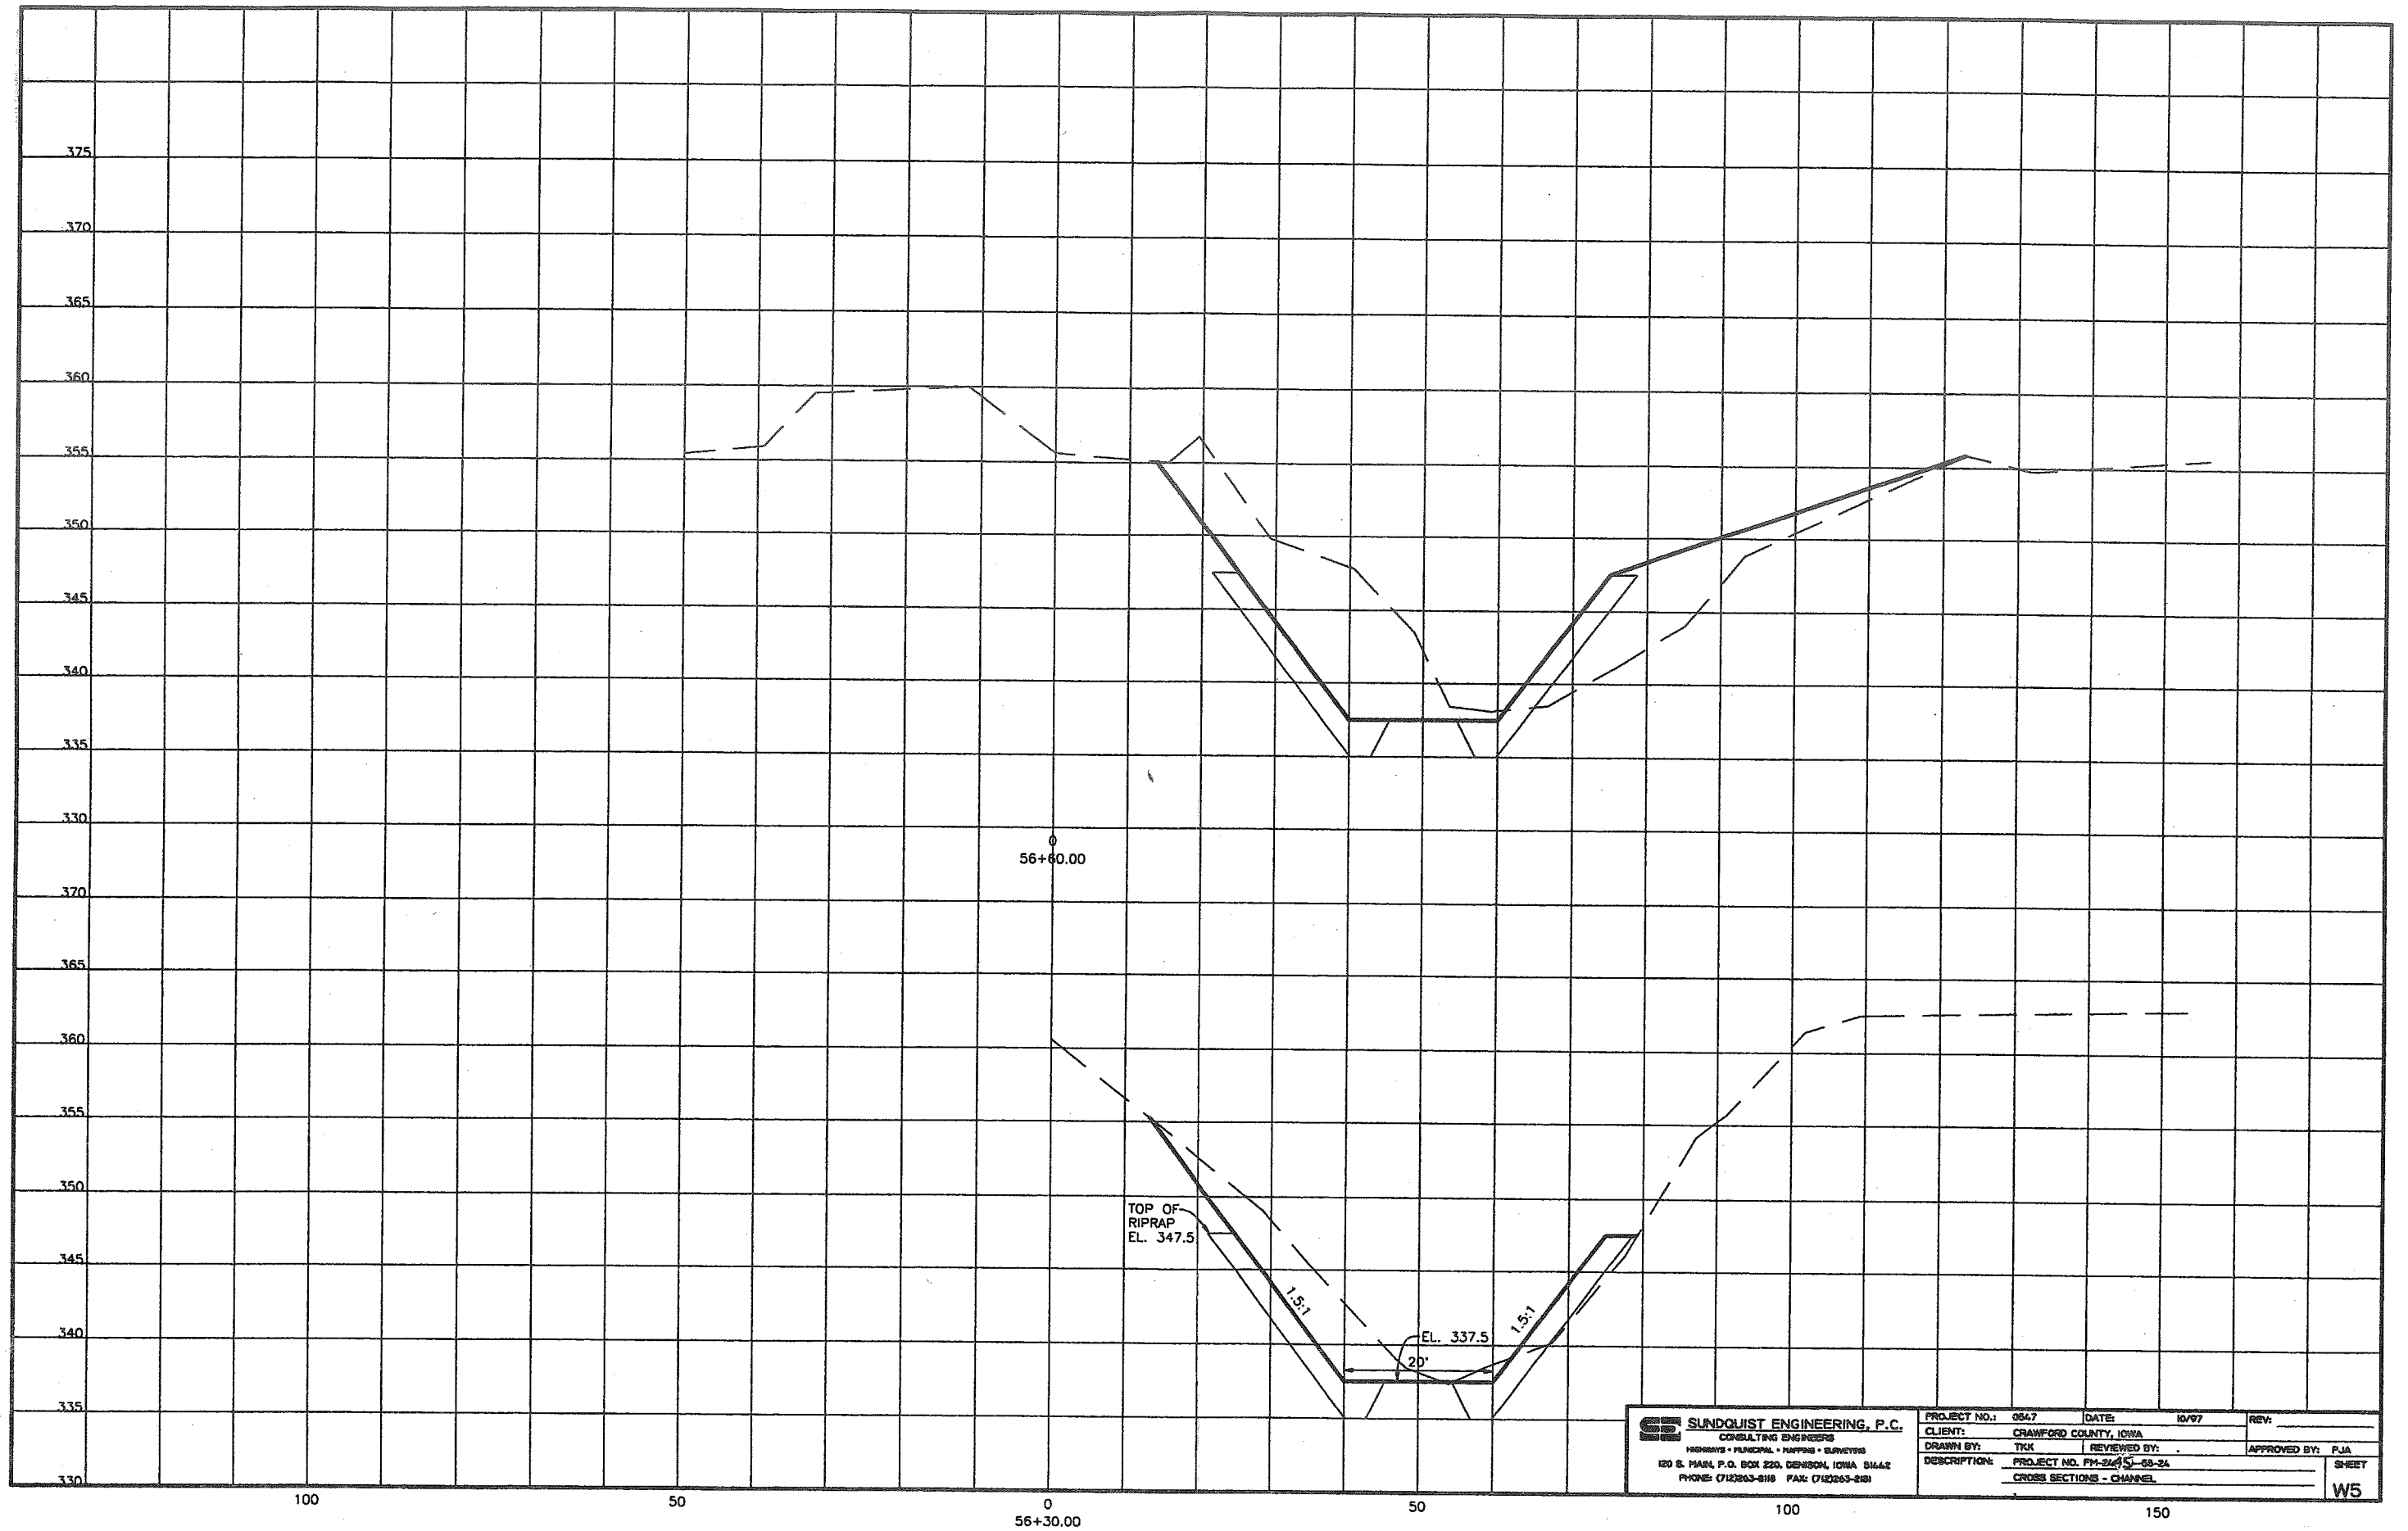

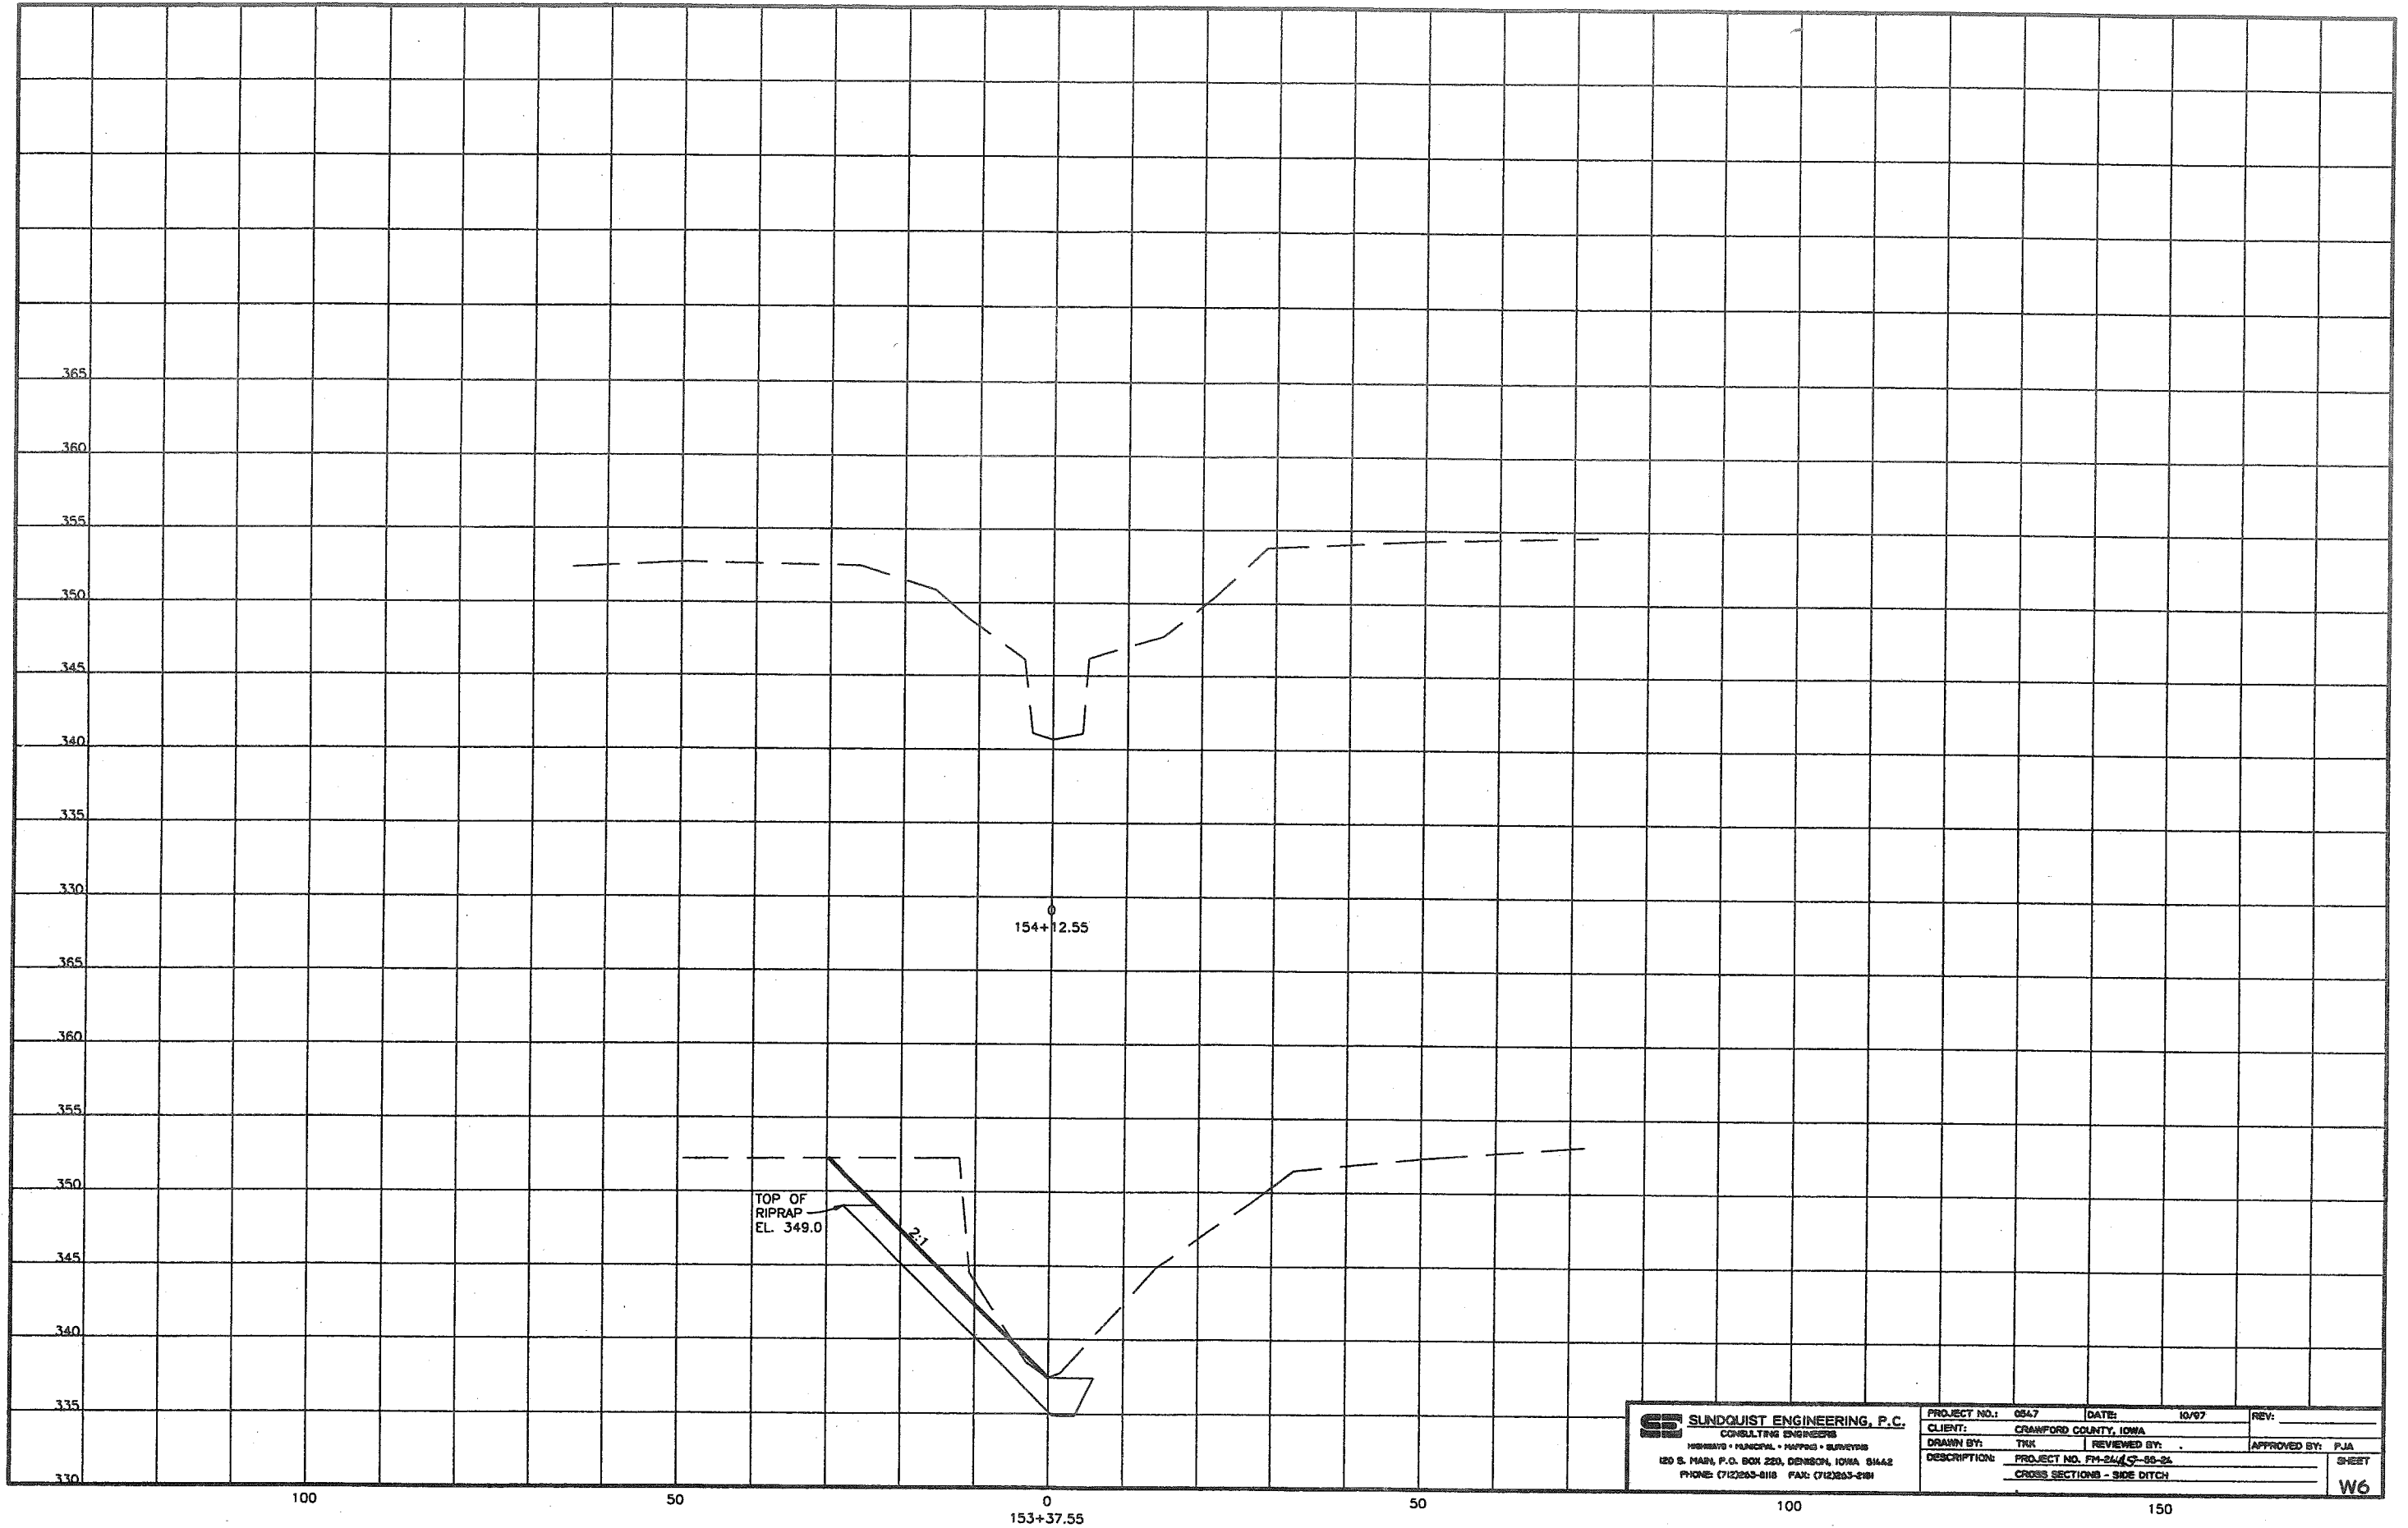


 <b>SUNDQUIST ENGINEERING, P.C.</b> CONSULTING ENGINEERS <small>HIGHWAYS • MUNICIPAL • MARINE • SURVEYING</small> 120 S. MAIN, P.O. BOX 220, DENSON, IOWA 51442 PHONE (712)263-8110 FAX (712)263-8101	PROJECT NO.: 0847	DATE: 10/07	REV:
	CLIENT: CRAWFORD COUNTY, IOWA	APPROVED BY: PJA	
	DRAWN BY: THK	REVIEWED BY:	
	DESCRIPTION: PROJECT NO. FH-24/C-55-24 CROSS SECTIONS - SIDE DITCH		
			SHEET <b>W6</b>